



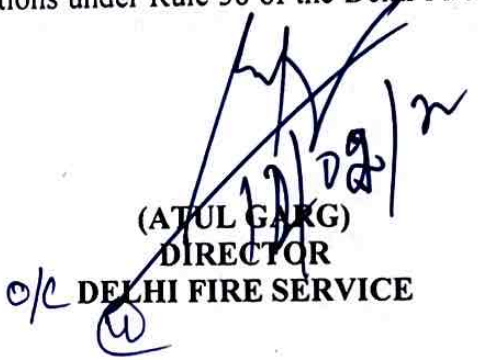
No. F6/DFS/MS/School/NDZ/2024/902

Dated: 12/09/2024

### FIRE SAFETY CERTIFICATE

Certified that the **St. Lawrence Convent (Manage by Gagan Educational Society)**, located at **Geeta Colony Facility Centre, Delhi - 110031**, building comprised of **ground plus three upper floors** owned/occupied by **M/s Gagan Educational Society**, was issued FSC vide letter No. F6/DFS/MS/School/2021/NDZ/744 dated 14/09/2021. The School building was re-inspected by the officer concerned of this department on 05/09/2024 in presence of Mr. Pankaj Jain (Manager) and found that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with the Rule 33 of the Delhi Fire Service Rules 2010 and that the premises is fit for occupancy class **Group B "Educational Building** with effect from 12/09/2024 for a period of **three years**, in accordance with rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules 2010, printed below.

Issued on 12/09/2024 at New Delhi by.

  
(ATUL GARG)  
DIRECTOR  
o/c DELHI FIRE SERVICE

#### Copy to:-

1. The Joint Director of Education (Land & Estate) Directorate of Education, Lucknow Road, Delhi - 110053.
2. The Principal, St. Lawrence Convent (Manage by Gagan Educational Society), located at Geeta Colony Facility Centre, Delhi - 110031.

#### Conditions for the validity of Fire Safety Certificate

1. The owner /occupier shall apply for renewal of this fire safety certificate to the Director in form 'J' [sub rule(1) of rule 37] along with a copy of this certificate, six months prior to its expiry
2. All the means of escape shall be kept free of all the type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
4. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
5. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
6. This Fire Safety Certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any..
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).



**INSPECTION REPORT**

01.	Name & address of the building	St. Lawrence Convent (Manage by Gagan Educational Society), located at Geeta Colony Facility Centre, Delhi - 110031.
02.	Building is comprised of	Ground plus three upper floors
03.	Type of occupancy	Educational Building
04.	Type of case	Renewal
05.	Details of previous FSC	F6/DFS/MS/School/2021/NDZ/744 dated 14/09/2021.
06.	Fire safety directives letter no.	F.16/Estate/CC/Fire safety/2011/3298 to 3398 dated 01/03/2011.
07.	Date of inspection	05/09/2024
08.	Name of the inspecting officers	Yashwant Singh Meena ADO (L.N)
09.	Name of the designation of officer from the building side	Mr. Pankaj Jain (Manager)
10.	Year of construction	2000
11.	Applicant's letter no.	Outdoor Dairy No. 5874 dated 02/09/2024

S.N o	Minimum standard of fire prevention and fire safety U/R	Requirement	Provided at site	Remarks MR/NMR
	33			

01.	<b>Access to Building:</b>			
	A	Road width	6.0 mtrs.	15 mtrs. ✓ MR
	B	Gate width	4.5 mtrs	06 mtrs ✓ MR
	C	Width of internal road	NA	NA ✓ NA

02.	<b>Number, Width, Type and Arrangement of Exits:</b>				
	A	Number of staircases			
		a	Upper floor	04 nos.	04 nos. ✓ MR
		b	Basement	NA	NA NA
	B	Width of staircases			
		a	Upper floor	1.50 mtrs	1.7 mtrs, 1.7 mtrs, 1.1 mtrs & 01 mtr ✓ MR (Accepted earlier)
		b	Basement	NA	NA NA
	C	Protection of exits			
		a	Fire check door	NA	NA NA
		b	Pressurization	NA	NA NA
	D	No. of continuous staircases to terrace	02 nos.	02 nos. ✓ MR	
	E	Width of corridor	1.50 mtrs.	1.50 mtrs. ✓ MR	
F	Door size	1.0 mtr.	1.0 mtr. ✓ MR		

03.	<b>Compartmentation:</b>			
	A	Fire check door	NA	NA NA
	B	Sealing of electrical shafts	NA	NA NA
	C	Fire rating of shaft door	NA	NA NA
	D	Water curtain	NA	NA NA
	E	Fire dampers	NA	NA NA

04.	<b>Smoke Management System:</b>			
	A	Basement	NA	NA NA
	B	Upper floor	NA	NA NA




<b>05. Fire Extinguisher:</b>				
A	Total numbers	30 nos.	30 nos.	MR
B	Types	ABC/CO <sub>2</sub>	ABC/CO <sub>2</sub>	MR
C	ISI marking	ISI marked	ISI marked	MR
<b>06. First-Aid-Hose Reel:</b>				
A	Total numbers of each floor	04 nos.	04 nos.	MR
B	Length of hose reel hose	30 mtrs	30 mtrs	MR
C	Nozzle diameter	05 mm	05 mm	MR
<b>07. Automatic Fire Detection and Alarming System:</b>				
A	Type of detectors	N/A	N/A	N/A
B	Location of main panel	N/A	N/A	N/A
C	Location of repeater panel	N/A	N/A	N/A
D	Alternate source of power	N/A	N/A	N/A
E	Hooters' Location	N/A	Provided	MR
<b>08. MOEFA:</b>		N/A	N/A	N/A
<b>09. Public Address System:</b>		N/A	Provided	MR
<b>10. Automatic Sprinkler System:</b>				
A	Basement	N/A	N/A	N/A
B	Upper floor	N/A	N/A	N/A
C	Sprinkler above false ceiling	N/A	N/A	N/A
<b>11. Internal Hydrants:</b>				
A	Size of riser/down-comer	N/A	N/A	N/A
B	Number of hydrants per floor	N/A	N/A	N/A
C	Hose box	N/A	N/A	N/A
<b>12. Yard Hydrants:</b>				
A	Total number of hydrants	N/A	N/A	N/A
B	Hose box	N/A	N/A	N/A
<b>13. Pumping Arrangements:</b>				
<b>1 Ground level</b>				
A	Discharge of main pump	N/A	N/A	N/A
B	Head of main pump	N/A	N/A	N/A
C	Number of main pumps	N/A	N/A	N/A
D	Jockey pump out put	N/A	N/A	N/A
E	Jockey pump head	N/A	N/A	N/A
F	Standby pump out put	N/A	N/A	N/A
G	Standby pump head	N/A	N/A	N/A
H	Auto starting /manual stopping	N/A	N/A	N/A
I	Pump house access	N/A	N/A	N/A
<b>2 Terrace Level</b>				
A	Discharge of pump	450 LPM	450 LPM X 2	MR
B	Head of the pump	40 m	40 m	MR
C	Power supply	Required	Provided	MR
D	Auto starting of pump	Required	Provided	MR



N/22  
**St. Lawrence Convent (For M/s Gagan Educational Society), Located at Geeta Colony  
 Facility Centre, Delhi-110031.**


<b>14. Captive Water Storage for Fire Fighting:</b>				
A	Underground tank capacity	50,000 ltrs	50,000 ltrs	MR
B	Draw-off connection	N/A	N/A	N/A
C	Fire service inlet	N/A	N/A	N/A
D	Access to tank	N/A	N/A	N/A
E	Overhead tank capacity	10,000 liters	30,000 liters	MR
		Required	Provided	MR
<b>15. Exit Signage:</b>				
<b>16. Provision of Lifts:</b>				
A	Pressurization of lift shaft	N/A	N/A	N/A
B	Pressurization of lift lobby	N/A	N/A	N/A
C	Communication in lift car	N/A	N/A	N/A
D	Firemen's grounding switch	N/A	N/A	N/A
E	Lift signage	N/A	Provided	MR
<b>17. Standby Power Supply:</b>				
<b>18. Refuge Area:</b>				
A	Total area	N/A	N/A	N/A
B	Location	N/A	N/A	N/A
<b>19. Fire Control Room:</b>				
A	Detector system panel	N/A	N/A	N/A
B	Flow switch panel	N/A	N/A	N/A
C	PA system panel	N/A	N/A	N/A
D	Battery backup	N/A	N/A	N/A
E	Building floor plans	N/A	N/A	N/A
<b>20. Special Fire Protection systems for protection of special Risks, if any:</b>		NA	N/A	N/A

The fire protection systems provided in the school building were tested, checked at random and found functional at the time of inspection.

Keeping in view of the deemed compliance of minimum standards of fire prevention and fire safety measures required as under the rules the FSC issued vide letter No. F6/DFS/MS/School/2021/NDZ/744 dated 14/09/2021, renewal under Rule 35 of the Delhi Fire Service Rules 2010, is recommended to be renewed.  
 No file is pending with me before disposal of this case.

  
 6/9/2024  
 Signature of the Inspecting Officer  
 Name: - Yashwant Singh Meena  
 Designation: - ADO (L.N)

DY. CFO/NDZ  
  
 C.F.O.  
  
 Director  
 11/9/2024  
 09/09/24

Sir.  
 F.T/Letter is put up for sign. Please  
 Director  
  
 19/9/2024