



**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001**

7  
अग्नि  
अमृत मलेनाद

No. F6/DFS/MS/WZ/2024/569

Dated: 19/09/2024

**FIRE SAFETY CERTIFICATE**

Certified that the M/s. **Galaxy Automobiles Pvt. Ltd.** located at **28, DLF Industrial Area, Moti Nagar, New Delhi-110015**, in a building comprised of 03 basement, ground, two upper floors, was issued FSC by this department vide letter no. F6/DFS/MS/WZ/2020/422 dated 19/10/2020. The premises was re-inspected by the officer concerned of this department on 18/09/2024 in the presence of Sh. Mukesh Jha and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service, 2010 and that the premises is fit for occupancy class "Industry" (Group-G) with effect from 19/09/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service, 2010, condition mentioned below.

Issued on 19/09/2024... at New Delhi by.

(Atul Garg)  
Director  
18/9/24

Copy to: -

1. The executive Engineer (Bldg.) HQ, MCD, 8<sup>th</sup> Floor, Civic Centre, JLN Road, New Delhi- 110002.
2. The owner/occupier, M/s. Galaxy Automobiles Pvt. Ltd. located at 28, DLF Industrial Area, Moti Nagar, New Delhi-110015.

**Following fire safety directives must be adhered to: -**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building by laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

## INSPECTION REPORT

1. Name & address of the building	M/s. Galaxy Automobiles Pvt. Ltd., Property No. 28, DLF Industrial Area, Moti Nagar, New Delhi-110015.
2. Type of Occupancy	Storage Occupancy (Workshop)
3. Type of Case	Renewal
4. Details of previous NOC	F6/DFS/MS/WZ/2020/422 dated 19/10/2020
5. Fire Safety directives letter No	F6/DFS/MS/BP/2010/3468 dated 21/09/2012
6. Date of inspection	18/09/2024
7. Name of the Inspecting Officers	Sarabjeet Singh ADO (MN)
8. Name and designation of officers from the building side	Sh. Mukesh (Jha)
9. Year of Construction	2016 (As per prev. Insp. report dtd- 15/09/2020)
10. Applicant's letter No.	Email dated 14/0292024,

The said building is comprised of 03 basement + Ground + 02 Upper floors.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Required as per Rule 35(6) of DFS Rule 2010	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	12 m	Provided	MR
	• Gate width	05 m	Provided	MR
	• Width of internal road	NA	NA	NA
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases			
	• Upper Floors	02	Provided	MR
	• Basements	02	Provided	MR
	b. Width of staircases			
	• Upper Floors	2 x 1.5m	Provided	MR
	• Basements	2 x 1.5m	1.05m & varies from 1.3 to 1.5m	MR(Old Case)
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	NA	NA	NA
	e. No. of continuous staircases to terrace	02	Provided	MR
	f. Width of Corridor	NA	NA	NA
	g. Door Size	1 mtr	Provided	MR
3	<b>Compartmentation.</b>			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	Required	Provided	MR
	• Fire Rating of shaft door	Required	Provided	MR
	• Water Curtain	Required	Provided	MR
	• Fire Dampers	NR	NR	NR
4	<b>Smoke Management System.</b>			
	• Basements	Required	Provided	MR
	• Upper floors	Required	Provided	MR
5	<b>Fire Extinguishers</b>			
	• Total numbers	45 Nos.	Provided	MR
	• Types	CO <sub>2</sub> , ABC type	Provided	MR
	• IS marking	ISI marked	Provided	MR





6	<b>First-Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> </ul>	02	Provided	MR
	<ul style="list-style-type: none"> <li>Length of hose reel hose</li> </ul>	30m	Provided	MR
	<ul style="list-style-type: none"> <li>Nozzle diameter</li> </ul>	5mm	Provided	MR
7	<b>Automatic fire detection and alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> </ul>	Smoke & Heat	Provided	MR
	<ul style="list-style-type: none"> <li>Location of Main Panel</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Location of Repeater Panel</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Alternate source of power</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Hooters' Location</li> </ul>	Required	Provided	MR
8	<b>MOEFA</b>	Required	Provided	MR
9	<b>Public Address System.</b>	NA	NA	NA
10	<b>Automatic Sprinkler System.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Upper Floor</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Sprinkler above false ceiling</li> </ul>	NA	NA	NA
11	<b>Internal Hydrants</b>			
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> </ul>	100 mm	Provided	MR
	<ul style="list-style-type: none"> <li>Number of hydrants per floor</li> </ul>	02	Provided	MR
	<ul style="list-style-type: none"> <li>Hose Box</li> </ul>	Required	Provided	MR
12	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Hose Box</li> </ul>	Required	Provided	MR
13	<b>Pumping Arrangements.</b>			
	<ul style="list-style-type: none"> <li>Ground Level <ul style="list-style-type: none"> <li>Discharge of main Pump</li> <li>Head of Main pump</li> <li>Number of main pumps</li> <li>Jockey Pump out put</li> <li>Jockey pump head</li> <li>Standby Pump out put</li> <li>Standby Pump Head</li> <li>Auto Starting/ Manual stopping</li> <li>Pump House Access</li> </ul> </li> <li>Terrace level <ul style="list-style-type: none"> <li>Discharge of pump</li> <li>Head of the pump</li> <li>Power Supply</li> <li>Auto Starting of pump</li> </ul> </li> </ul>	2850 LPM	Provided	MR
		60 mtr	Provided	MR
		01	Provided	MR
		180 LPM	Provided	MR
		60 mtr	Provided	MR
		2850 LPM	Provided	MR
		60	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		450 lpm	Provided	MR
		40 m	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
14	<b>Captive Water Storage for fire fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity</li> </ul>	1,00,000 ltr	Provided	MR
	<ul style="list-style-type: none"> <li>Draw-off connection</li> </ul>	NR	Provided	MR
	<ul style="list-style-type: none"> <li>Fire service inlet</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Access to tank</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>Overhead Tank capacity</li> </ul>	10,000 ltrs	Provided	MR
15	<b>Exit Signage.</b>	Required	Provided	MR


Provision of Lifts.				
	• Pressurization of Lift Shaft	Required	Provided	MR
	• Pressurization of Lift lobby	Required	Provided	MR
	• Communication In lift Car	Required	Provided	MR
	• Fireman's Grounding Switch	Required	Provided	MR
	• Lift Signage	Required	Provided	MR
17	<b>Standby power supply</b>	Required	Provided	MR
18	<b>Refuge Area.</b>			
	➤ Total Area	NA	NA	NA
	➤ Location	NA	NA	NA
19	<b>Fire Control Room</b>			
	• Detector System Panel	NA	NA	NA
	• Flow Switch Panel	NA	NA	NA
	• PA System Panel	NA	NA	NA
	• Batter backup	NA	NA	NA
	• Building Floor Plans	NA	NA	NA
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA

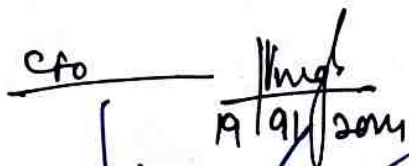
Fire protection system provided in the building were provided in the building were test and found functional at the time of inspection. Earlier all the shortcomings issued by this department have been complied by the owner/management of the building.

In view the deemed compliance of the minimum standards on Fire Prevention and fire safety required under the rules the FSC was issued by this department vide letter No.F6/DFS/MS/WZ/2020/422 dated 19/10/2020.

*By cfo (1/2)*  


*SP*  
  
 Signature of the Inspecting Officer  
 Name: - Sarabjeet Singh  
 Designation: - ADO (MN)

*SP*  
  
 18/9

*cfo*  
  
 19/9/2021

*Director*  
  
 19/9/21

*18/9/2021*