

c/23

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE

NEW DELHI-110 001.

No.F.6/DFS/MS/School/2024/SZ/ 937

Dated: 26/09/2024

FIRE SAFETY CERTIFICATE

Certified that the building of **Nagar Nigam Prathmik Pratibha Bal Vidyalaya**, Najafgarh No. I/II, New Delhi-110043, comprised of two blocks namely A-Block and B-Block, A-block is having Ground plus one upper floor & B-Block is having Ground plus two upper floors owned occupied by Nagar Nigam Prathmik Pratibha Bal Vidyalaya was issued FSC by this department vide letter no. F.6/DFS/MS/School2021/SZ/705 dated 03.09.2021. The school building was re-inspected by the officer concerned of this department on 20.09.2024 in the presence of Sh. Yashpal Singh (Principal) and found that School building have deemed complied the fire prevention and fire safety requirements in accordance with Rule 33 of the Delhi Fire Service Rules, 2010 and that the building/ premises is fit for occupancy class "Educational" w.e.f. 26/09/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule-38 of the Delhi Fire Service Rules, 2010 printed as below.

Issued on 26/09/2024 at New Delhi by.


(Atal Garg)

Director

Delhi Fire Service

Copy to: -

1. The Principal, Nagar Nigam Prathmik Pratibha Bal Vidyalaya, Najafgarh No. I/II, New Delhi-110043.
2. Director of Education, GNCT of NCT of Delhi, Old Secretariat, New Delhi- 110054.

Conditions for the validity of fire safety certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

N/16

INSPECTION REPORT

1. Name & address of the building : Nagar Nigam Prathmik Pratibha Bal Vidyalaya, Najafgarh No. I/II, New Delhi-110043.
2. Building is comprised of : Two blocks A-Blk (G+ 1) & B-Blk (G+2)
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous NOC : F.6/DFS/MS/School2021/SZ/705 dated 03.09.2021
6. Fire Safety directives letter No : N/A
7. Date of inspection : 20.09.2024
8. Name of Inspecting Officer : A.D.O. R.K. Yadav
9. Name and designation of officers
From the building side : Sh. Yashpal Singh (Principal)
10. Year of Construction : Before 2010 & 2013
11. Applicant's letter No. : Nil dated Nil (outdoor dairy No. 5725 dated 28.08.2024)

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Accessible 06 m 4.5 m NA	Provided 4.6 & 1.5 m. NA	M/R MR NA
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> Upper Floors Basements 	NB -01 No. & OB -02 No's	A-blk -01 No. & B-blk -02 No's	M/R
		N/A	N/A	N/A
	b. Width of staircases			
	<ul style="list-style-type: none"> Upper Floor Basements 	1.50 m	A-blk 1.65 m & B-blk 1.50 & 1.51 m	M/R
		N/A	N/A	N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A	N/A	N/A
		N/A	N/A	N/A
	d. No. of continuous staircases to terrace	Required	Provided	MR
		1.50 m	A-blk 2.11 m & B-blk 1.50 m	M/R
	e. Width of Corridor			
	f. Door Size	1.0 m	1.16 m (Double door)	M/R
3.	Compartmentation			
	<ul style="list-style-type: none"> Fire check door Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
4.	Smoke Management System			
	<ul style="list-style-type: none"> Basements Upper floors 	N/A	N/A	N/A
		Required	Natural Ventilation	M/R
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	15 no's ABC/CO ₂ type ISI marked	Provided	M/R
			Provided	M/R
			ISI marked	M/R
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	Required 30 m 05 mm	Provided	M/R
			Provided	M/R
			Provided	M/R

N/17




7.	Automatic fire detection and alarming system			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	Provided	M/R
10.	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Ground Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down-comer	N/A	Provided 100 mm	M/R
	• Number of hydrants per floor	N/A	Provided One	M/R
	• Hose Box	N/A	Provided	M/R
12.	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13.	Pumping Arrangements			
	• Ground Level			
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey Pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/Manual Stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	450 LPM	Provided	M/R
	➤ Head of the pump	40 mtrs	Provided	M/R
	➤ Power Supply	Required	Provided	M/R
	➤ Auto Starting of pump	Required	Provided	M/R
14.	Captive Water Storage for fire fighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	Provided	M/R
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	10,000 ltrs.	Provided	M/R
15.	Exit Signage.	Required	Provided	M/R
16.	Provision of Lifts.			
			(No Lift)	
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	N/A	N/A	N/A
	• Fireman's Grounding Switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A

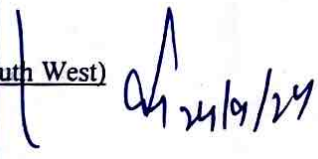
N/18

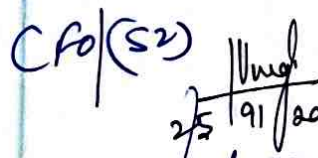
	Standby power supply	N/A	N/A	N/A
18.	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risks, if any:	N/A	N/A	N/A


The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the Fire Safety Certificate issued vide letter number F.6/DFS/MS/School2021/SZ/705 dated 03.09.2021, renewal under rule 37 of the Delhi Fire Service Rules 2010 is recommended.


 Signature of Inspecting Officer
 Name: - R.K. Yadav
 Designation: - ADO (JKP)

DO (South West) 
 24/9/24

CFo(S2) 
 25/9/2024

Director 
 25/9/24

