

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110001

No. F6/DFS/MS/School/2024/SZ/ 1033

Dated: 18/10/2024

FIRE SAFETY CERTIFICATE

Certified that the New S.D. Public School running at ground & first floor only of building comprised of ground plus two upper floors located at Defence Enclave, Balaji Chowk, Mohan Garden, Uttam Nagar, New Delhi- 110059, was issued FSC by this department vide letter No F.6/DFS/MS/school/2021/SZ/409 dated 28.06.2021. The school building was re-inspected by the officer concerned of this department on dated 30.09.2024 in the presence of Sh. Sanjay Agarwal (Manager) and found that the School building have deemed complied with the fire prevention and fire safety requirements in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education and that the building/ premises (**Ground and first floor only**) is fit for occupancy class "**Educational**" for a period of three years, subject to compliance of the conditions printed below.

Issued on 18/10/2024 at New Delhi.


 (Atul Garg)
 Director
 Delhi Fire Service

Copy to:-

1. The Principal, New S.D. Public School at Defence Enclave, Balaji Chowk, Mohan Garden, Uttam Nagar, New Delhi- 110059.
2. Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi – 110054.

Conditions for the validity of fire safety certificate: -

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. The means of escape shall be kept unlocked and unobstructed for unhindered evacuation of occupants in case of emergency.
3. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
4. The trained staff should be available round the clock.
5. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in the Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT

- N/12
1. Name & address of the building : New S.D.Public School, Defence Enclave, Balaji Chowk, Mohan Garden, Uttam Nagar, New Delhi.
 2. Building is comprised of : G+2 But school running at G+1 floor only
 3. Type of Occupancy : Educational
 4. Type of Case : Renewal
 5. Details of Previous NOC : F.6/DFS/MS/school/2021/SZ/409 dated 28.06.2021
 6. Fire Safety direction letter No : N/A
 7. Date of Inspection : 30.09.2024
 8. Name of the Inspecting Officers: : ADO R.K. YADAV
 9. Name of the designation of Officer from the building side : Sh. Sanjay Aggarwal (Manager)
 10. Year of Construction : Before 2006 & 2014
 11. Applicant's letter No : Nil, dated -24.08.2024

S. No.	Minimum Standards on fire prevention and fire safety U/R33	Requirement	Provided at Site	Remarks MR/NMR
1	Access to building			
	Road width	Accessible.	5.50 m	MR, old case
	Gate width	N.A.	N.A.	N.A.
	Width of internal road	N.A.	N.A.	N.A.
2	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	Upper Floor	2 nos.	2 nos.	MR
	Basement	N.A.	N.A.	N.A.
	B. Width of Staircases	N.A.	N.A.	N.A.
	Upper Floor	1.50 m & .75 m	1.23, 1.23 to 1.50 m	MR
	Basement	N.A.	N.A.	N.A.
	c. Protection of exits			
	Fire check door	N.A.	N.A.	N.A.
	Pressurization	N.A.	N.A.	N.A.
	e. No. of continuous staircases to terrace	N.A.	01 no.	MR
g. Width of Corridor	1.50 m	2.25 & 1.42 m	MR	
h. Door Size	1 m	0.90 m	MR, old case	
3	Compartmentation.			
	Fire check door	N.A.	N.A.	N.A.
	Sealing of electrical shafts	N.A.	N.A.	N.A.
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	N.A.	N.A.	N.A.
	Upper floor	Required	Natural Ventilation provided	MR

PK

h

N/B

5.	Fire Extinguisher			MR
	Total numbers	08 Nos.	08 Nos.	MR
	types	CO ₂ & ABC	CO ₂ & ABC	MR
	IS marking	ISI marked	ISI marked	MR
6	First-aid-Hose Reels.			
	Total numbers of each floor	N.A.	Provided	MR
	Length of hose reel hose	N.A.	Provided	MR
	Nozzle diameter	N.A.	Provided	MR
7	Automatic fire detection and alarming system.			
	Type of detectors	N.A.	N.A.	N.A.
	Location of main panel	N.A.	N.A.	N.A.
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	N.A.	N.A.	N.A.
	Hooters	N.A.	Provided	MR
8	MOEFA	N.A.	N.A.	N.A.
9	Public address System.	N.A.	N.A.	N.A.
10	Automatic Sprinkler System.			
	basement	N.A.	N.A.	N.A.
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	N.A.	N.A.	N.A.
	Number of hydrants per floor	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
12	Yard Hydrants.			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	Pumping Arrangements.			
	• Ground Level	N.A.	N.A.	N.A.
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main Pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	N.A.	N.A.	N.A.
	➤ Pump House Access	N.A.	N.A.	N.A.
	• Terrace Level			
	➤ Discharge of pump	N.A.	450 LPM	N.A.
	➤ Head of the Pump	N.A.	40 M	N.A.
	➤ Power supply	N.A.	Provided	N.A.
	➤ Auto Starting of pump	N.A.	N.A.	N.A.
14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	N.A.	N.A.	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	N.A.	10,000 Liters	MR
15	Exit Signage.	Required	Provided	MR

N/18


MR


16	Provision of Lifts.	N.A.	N.A.	N.A.
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
17	Standby power supply	N.A.	N.A.	N.A.
	Refuge Area.			
18	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	N.A.	N.A.	N.A.

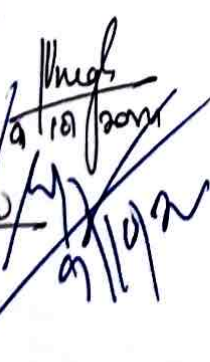
The fire protection systems provided in the building were test checked and found functional at the time of inspection.


In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the FSC issued vide letter number F.6/DFS/MS/school/2021/SZ/409 dated 28.06.2021, renewal in accordance with the Circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by the Director of Education is recommended.

Note: - As per undertaking given by school management (placed at C-15) School is running at ground floor and first floor only in a building comprised of ground plus two upper floors. Second floor is not use for school purpose (photo enclosed with undertaking).


 Signature of Inspecting Officer
 Name: - R.K. Yadav
 Designation: - ADO (JKP)

DO (South West) 
 8/10/24

CFO (S2) 
 9/10/2021

Director 
 9/10/22

