

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE NEW DELHI-110001

No. F6/DFS/MS/2024/School/WZ/ 1022

Dated: 15/10/2024

FIRE SAFETY CERTIFICATE

Certified that The Heritage School, Plot No.8, Sector-23, Rohini, Delhi-110085, comprised of Basement + Ground + Three upper floors owned/occupied by The Heritage School, has already been issued FSC by this department vide letter No. F.6/DFS/MS/2021/School/WZ/813 dated 05.10.2021. The premises was re-inspected by the officer concerned of this department on 30.09.2024 in the presence of Smt. Yakshi Gulati (Principial) and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premises have therefore deemed complied with the requirements under Rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy under Educational "Group B" with effect from 15/10/2024 for a period of **three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subjected to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 15/10/2024 at New Delhi by

(Atul Garg)
DIRECTOR

Ph; 011-23414000

Copy to :-

1. The Principal, The Heritage School, Plot No.8, Sector-23, Rohini, Delhi-110085.
2. The Director of Education, Old Secretariat, Delhi

Conditions for validity of Fire Safety Certificate;

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The basement shall only be used as per BBL 1983.
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director along with a copy of this Certificate, six months prior to its expiry".
8. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on

http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/

http://www.delhi.gov.in/wps/wcm/connect/doiit_fire/FIRE/Home/Forms

INSPECTION REPORT

19/50

1. Name & address of the building	The Heritage School, Plot No.8, Sectro-23, Rohini, Delhi-110085
2. Type of Occupancy	Educational
3. Type of Case	Renewal (Basement + Ground + 03 upper floors)
4. Details of Previous NOC	F.6/DFS/MS/2021/School/WZ/813 dated 05.10.2021.
5. Fire Safety directives letter No	NBC Part-IV.
6. Date of inspection	30.09.2024.
7. Name of Inspecting Officer	Sh. Ajay Kumar Sharma (ADO Rohini)
8. Name and designation of officers From the building side	Smt. Yakshi Gulati (Principal)
9. Year of Construction	2003
10. Applicant's letter No.	Online e-mail dated 05.09.2024.

S. No	Minimum Standards on fire prevention and fire safety U/R 33	NBC Part-IV Requirement	Provided at site	Remarks MR/NMR
-------	---	-------------------------	------------------	-------------------

1.	Access to building			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	4.5m	MR
	• Width of internal road	-NA-	-NA-	-NA-

2. Number, Width, Type & Arrangement of Exits

	g. Number of staircases			
	• Upper Floors	04nos.	04nos.	MR
	• Basements	04nos.	04nos.	MR
	h. Width of staircases			
	• Upper Floor	1.5m	Provided	MR
	• Basements	1.5m	Provided	MR
	i. Protection of exits			
	• Fire check door	Required in basement	Provided	MR
	• Pressurization	-NA-	-NA-	-NA-
	d. No. of continuous staircases to terrace	02nos.	Provided	MR
	e. Width of Corridor	-NA-	-NA-	-NA-
	f. Door Size	Required	Provided	MR

3. Compartmentation

	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	-NA-	-NA-	-NA-
	• Fire Rating of shaft door	-NA-	-NA-	-NA-
	• Water Curtain	-NA-	-NA-	-NA-
	• Fire Dampers	-NA-	-NA-	-NA-

4. Smoke Management System

	a) Basements	30 /c per hour	Exhaust fan	MR
	b) Upper floors	12 a/c per hour	Natural ventilated	MR

5. Fire Extinguishers

	• Total numbers	28nos.	Provided	MR
	• Types	ABC/CO2	ABC/CO2	MR
	• IS marking	ISI marked	Yes	MR

5. First-Aid Hose Reels


	• Total numbers on each floor	03nos.	Provided	MR
	• Length of hose reel hose	30mm	Provided	MR
	• Nozzle diameter	5m	Provided	MR

7.	Automatic fire detection and alarming system			-NA-	-NA-	-NA-
	a) Type of detectors		-NA-	-NA-	-NA-	-NA-
	b) Location of Main Panel		-NA-	-NA-	-NA-	-NA-
	c) Location of Repeater Panel		-NA-	-NA-	-NA-	-NA-
	d) Alternate source of power		-NA-	-NA-	-NA-	-NA-
	e) Hooters' Location		Required	Provided		MR
8.	MOEFA			Required	Provided	MR
9.	Public Address System					
10.	Automatic Sprinkler System			Required	Provided	MR
	• Basement		-NA-	-NA-	-NA-	-NA-
	• Ground & Upper Floors		-NA-	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling					
11.	Internal Hydrants			100mm	Provided	MR
	• Size of riser/down-comer		03nos.	Provided		MR
	• Number of hydrants per floor		03nos.	Provided		MR
	• Hose Box					
12.	Yard Hydrants			Required	Provided	MR
	• Total number of hydrants		Required	Provided		MR
	• Hose Box					
13.	Pumping Arrangements			Required	1620lpm	MR
	• Ground Level		Required	40m		MR
	➤ Discharge of main Pump		-NA-	-NA-		-NA-
	➤ Head of Main pump		Required	180lpm		MR
	➤ Number of main pumps		Required	40m		MR
	➤ Jockey Pump out put		-NA-	-NA-		-NA-
	➤ Jockey pump head		-NA-	-NA-		-NA-
	➤ Standby Pump out put		-NA-	-NA-		-NA-
	➤ Standby Pump Head		-NA-	-NA-		-NA-
	➤ Auto Starting/Manual Stopping		Required	Provided		MR
	➤ Pump House Access		Required	Provided		MR
	Terrace level					
	➤ Discharge of pump		450lpm	Provided		MR
	➤ Head of the pump		40m	Provided		MR
	➤ Power Supply		Required	Provided		MR
	➤ Auto Starting of pump		Required	Provided		MR
14.	Captive Water Storage for fire fighting					
	• Underground tank capacity		-NA-	20,000ltr		MR
	➤ Draw-off connection		-NA-	-NA-		-NA-
	➤ Fire service inlet		-NA-	-NA-		-NA-
	➤ Access to tank		-NA-	-NA-		-NA-
	• Overhead Tank capacity		15,000ltr	Provided		MR
15.	Exit Signage.			Required	Provided	MR
16.	Provision of Lifts.					
	• Pressurization of Lift Shaft		-NA-	-NA-		-NA-
	• Pressurization of Lift lobby		-NA-	-NA-		-NA-
	• Communication In lift Car		-NA-	-NA-		-NA-
	• Fireman's Grounding Switch		-NA-	-NA-		-NA-
	• Lift Signage		-NA-	-NA-		-NA-



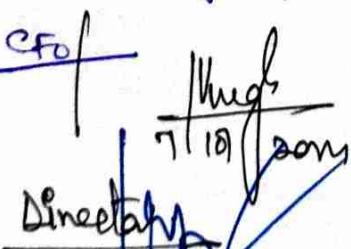

	Standby power supply			
	Refuge Area.	-NA-	-NA-	-NA-
	➤ Total Area			
	➤ Location	-NA-	-NA-	-NA-
19.	Fire Control Room	-NA-	-NA-	-NA-
	• Detector System Panel	-NA-	-NA-	-NA-
	• Flow Switch Panel	-NA-	-NA-	-NA-
	• PA System Panel	-NA-	-NA-	-NA-
	• Battery backup	-NA-	-NA-	-NA-
	• Building Floor Plans	-NA-	-NA-	-NA-
20.	Special Fire Protection System for Protection of special Risks, if any:	-NA-	-NA-	-NA-

Accordingly, the fire protection systems provided in the building were tested/ checked randomly and found in working condition at the time of inspection.

In view of the deemed compliance of the minimum standards of the fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. **F.6/DFS/MS/2021/School/WZ/813 dated 05.10.2021** is recommended for renewal under rule 37 of the Delhi Fire Service rules 2010.

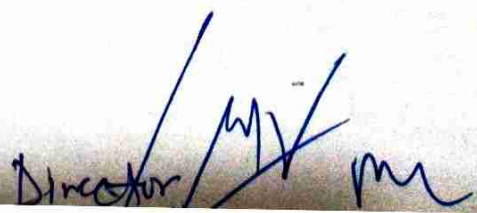

 Signature of the Inspecting Officer
 Name **Ajay Kumar Sharma**
 Designation **ADO(Rohini)**

D.B Mukherjee
DO (NW)


 04/10/2024
 Dy Cfo (202)

 5/10
 Cfo

 7/10/2024
 Director

 8/10/2024

Dated..... 4/10/2024

Any other fr letter is put up for kind perusal on signature please.


 Director

