

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS : DELHI FIRE SERVICE, NEW DELHI - 110001**

C 114

No: F6/DFS/MS/EH/NDZ/2024/ 355

Dated: 28/10/2024

**FIRE SAFETY CERTIFICATE**

Certified that the M/s Haldiram Product Pvt. Ltd. located at Shop No. 1454, 1455 & 1456, Near Fountain Chandni Chowk, Delhi - 06, comprised of Ground + 03 upper floors + tin shed on terrace, [ground floor (display & sale counter), 1<sup>st</sup> floor & 2<sup>nd</sup> floor (restaurant use), 3<sup>rd</sup> floor (Kitchen), tin shed at terrace (utility area + LPG bank), but restaurant is running at ground + 02 upper floors only. The building/ premises was re-inspected by the team of officers concerned of this department on 18.10.2024 in presence of Mr. Sudhir Sharma (Manager) and found that the premises/building has deemed complied with the fire prevention and fire safety requirements in accordance with Rule 33 of Delhi Fire Service Rules, 2010. Accordingly, the premises is fit for occupancy class (Group-D) "Assembly Building", (restaurant running at ground + 02 upper floors only) with effect from 28/10/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to conditions under Rule 38 of Delhi Fire Service Rules, 2010 printed below.

Issued on ..... 28/10/2024 ..... at New Delhi by

(Atul Gang)  
Director  
Delhi Fire Service  
Tel: 011-23414000  
9/2/2024

**Copy to:-**

1. The Joint Commissioner of Police (Licensing), 1st Floor, Police Station Defence Colony, New Delhi: - Ref. MHA Portal ID. No. 2024100915460 dated 09.10.2024: to ensure the occupancy as detailed above and online application.
2. The Medical Officer of Health,  
Health Department, Municipal Corporation of Delhi, Civic Centre, Minto Road, New Delhi - 02.
3. The Licensee, M/s Haldiram Product Pvt. Ltd. at Shop No. 1454, 1455 & 1456, Near Fountain Chandni Chowk, Delhi - 06.

**Condition for the validity of fire safety certificate**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
7. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub Rule (I) of Rule 37] along with a copy of this Certificate, six month prior to its expiry. Any change in the occupancy shall be intimated to this Deptt. and approval shall be obtained thereto before occupancy of the same.

## INSPECTION REPORT


|      |  |   |                  |                      |  |
|------|--|---|------------------|----------------------|--|
| 1    | Name & address of the building   | M/s Haldiram Products Pvt. Ltd. at 1454-1455-1456, Near Fountain Chandni Chowk, Delhi.  |                  |                      |  |
| 2    | Building is comprised of   | (Ground + 03 upper floor + tin shed construction on terrace[ground floor (display & sale counter), 1 <sup>st</sup> floor & 2 <sup>nd</sup> floor (restaurant use), 3 <sup>rd</sup> floor (Kitchen), tin shed at terrace (utility area + LPG bank) |                  |                      |  |
| 3    | Type of occupancy  | Assembly Building- "Group-D" (Restaurant)   |                  |                      |  |
| 4    | Type of case   | New case  |                  |                      |  |
| 5    | Details of previous FSC  | NA  |                  |                      |  |
| 6    | Fire safety direction letter no.   | NA  |                  |                      |  |
| 7    | Date of inspection   | 18.10.2024  |                  |                      |  |
| 8    | Name of the inspecting officers  | Rajinder Atwal, DO (CD) & Sumit Kumar, ADO (SPM)  |                  |                      |  |
| 9    | Name of the designation of officer from the building side                | Mr. Sudhir Sharma (Manager)   |                  |                      |  |
| 10   | Year of construction   | Before 2005   |                  |                      |  |
| 11   | Applicant's letter no.   | Online application no. 2024100915460 dated 09.10.2024   |                  |                      |  |
| S.No | Minimum Standards on fire Prevention and fire safety requirements U/R 33 | Requirements/ Existing fire safety arrangements   | Provided at Site | Remarks MR/ NMR      |  |
| 1    | <b>Access To Building:</b>   |   |                  |                      |  |
|      | Road width   | 06 mtrs.  | 12 mtrs.         | MR                   |  |
|      | Gate width   | NA  | NA               | NA                   |  |
|      | Width of internal road   | NA  | NA               | NA                   |  |
| 2    | <b>Number, Width, Type and Arrangement of Exits:</b>                     |   |                  |                      |  |
|      | <b>A</b>   | Number of staircases  |                  |                      |  |
|      | a  | Upper floor   | 02 nos.          | 03 nos.              | MR   |
|      | b  | Basement  | NA               | NA                   | NA   |
|      | c  | No. of Exits/door at ground floor   | 02 nos.          | 02 nos.              | MR   |
|      | <b>B</b>   | Width of staircases   |                  |                      |  |
|      | a  | Upper floor   | 1.5 m & 1.0 m    | 1.5 m, 1.0 m, 0.96 m | MR(as per circular 4/22/2004/HP -III/356-369 dated 22.03.2005) |
|      | B  | Basement  | NA               | NA                   | NA   |
|      | C  | Width of Exits/door at ground floor   | 2.0 m            | 2.0 m & 1.0 m        | MR   |
|      | <b>C</b>   | Protection of exits   |                  |                      |  |
|      | a  | Fire check door   | NA               | NA                   | NA   |
|      | b  | Pressurization  | NA               | NA                   | NA   |
|      | <b>D</b>   | No. of continuous staircases to terrace   | 01 no.           | 01 no.               | MR   |
|      | <b>E</b>   | Width of corridor   | NA               | NA                   | NA   |
|      | <b>F</b>   | Door size   | 2 mtrs.          | Provided             | MR   |
| 3    | <b>Compartmentation:</b>   |   |                  |                      |  |
|      | <b>A</b>   | Fire check door   | NA               | NA                   | NA   |
|      | <b>B</b>   | Sealing of electrical shafts  | NA               | NA                   | NA   |
|      | <b>C</b>   | Fire rating of shaft door   | NA               | NA                   | NA   |
|      | <b>D</b>   | Water curtain   | NA               | NA                   | NA   |
|      | <b>E</b>   | Fire dampers  | NA               | NA                   | NA   |
| 4    | <b>Smoke Management System:</b>  |   |                  |                      |  |
|      | <b>A</b>   | Upper floors  | 12 ACPH          | Exhaust fan          | MR   |
|      | <b>B</b>   | Basements   | NA               | NA                   | NA   |


|           |  |                   |                          |           |
|-----------|--|-------------------|--------------------------|-----------|
| <b>5.</b> | <b>Fire Extinguisher:</b>                            |                   |                          |           |
| <b>A</b>  | Total numbers  | 12 nos.           | 13 nos.                  | <b>MR</b> |
| <b>B</b>  | Types  | ABC & Co2         | Provided                 | <b>MR</b> |
| <b>C</b>  | ISI marking  | Required          | Provided                 | <b>MR</b> |
| <b>6</b>  | <b>First-Aid-Hose Reels:</b>                         |                   |                          |           |
| <b>A</b>  | Total numbers at each floor                          | 01 no.            | 01 no.                   | <b>MR</b> |
| <b>B</b>  | Length of hose reel hose                             | 30 mtr.           | 30 mtr.                  | <b>MR</b> |
| <b>C</b>  | Nozzle diameter                                      | 05 mm             | 05 mm                    | <b>MR</b> |
| <b>7</b>  | <b>Automatic Fire Detection And Alarming System:</b> |                   |                          |           |
| <b>A</b>  | Type of detectors (smoke)                            | NA                | Provided                 | <b>MR</b> |
| <b>B</b>  | Location of main panel                               | NA                | Provided                 | NA        |
| <b>C</b>  | Location of repeater panel                           | NA                | NA                       | NA        |
| <b>D</b>  | Alternate source of power                            | NA                | NA                       | NA        |
| <b>E</b>  | Hooters Location                                     | NA                | Provided at ground floor | NA        |
| <b>8</b>  | <b>MOEFA:</b>  | Required          | Provided at every floor  | <b>MR</b> |
| <b>9</b>  | <b>Public Address System:</b>                        | Required          | Provided                 | <b>MR</b> |
| <b>10</b> | <b>Automatic Sprinkler System:</b>                   |                   |                          |           |
| <b>A</b>  | Basement   | NA                | NA                       | NA        |
| <b>B</b>  | Upper floor  | Required          | Provided                 | <b>MR</b> |
| <b>C</b>  | Sprinkler above false ceiling                        | NA                | NA                       | NA        |
| <b>11</b> | <b>Internal Hydrants:</b>                            |                   |                          |           |
| <b>A</b>  | size of riser/down-comer                             | Required - 100 mm | Provided                 | <b>MR</b> |
| <b>B</b>  | Number of hydrants per floor                         | 01 no.            | 01 no.                   | <b>MR</b> |
| <b>C</b>  | Hose box   | 01 no.            | 01 no.                   | <b>MR</b> |
| <b>12</b> | <b>Yard Hydrants:</b>                                |                   |                          |           |
| <b>A</b>  | Total number of hydrants                             | NA                | NA                       | NA        |
| <b>B</b>  | Hose box   | NA                | NA                       | NA        |
| <b>13</b> | <b>Pumping Arrangements:</b>                         |                   |                          |           |
| <b>A</b>  | Ground level   |                   |                          |           |
| a)        | Discharge of main pump                               | NA                | NA                       | NA        |
| b)        | Head of main pump                                    | NA                | NA                       | NA        |
| c)        | Number of main pumps                                 | NA                | NA                       | NA        |
| d)        | Jockey pump out put                                  | NA                | NA                       | NA        |
| e)        | Jockey pump head                                     | NA                | NA                       | NA        |
| f)        | Standby pump out put                                 | NA                | NA                       | NA        |
| g)        | Standby pump head                                    | NA                | NA                       | NA        |
| h)        | Auto starting /manual stopping                       | NA                | NA                       | NA        |
| i         | Pump House Access                                    | NA                | NA                       | NA        |
| <b>B</b>  | Terrace level  |                   |                          |           |
| a)        | Discharge of pump                                    | 450 LPM           | 900 LPM                  | <b>MR</b> |
| b)        | Head of the pump                                     | 40 m              | 40 m                     | <b>MR</b> |
| c)        | Power supply   | Required          | Provided                 | <b>MR</b> |
| d)        | Auto starting of pump                                | Required          | Provided                 | <b>MR</b> |


|    |   |  |          |    |
|----|---|--|----------|----|
| 14 | <b>Captive Water Storage For Fire Fighting:</b>                                 |  |          |    |
| A  | Underground tank capacity   | NA   | NA       | NA |
| B  | Draw-off connection   | NA   | NA       | NA |
| C  | Fire service inlet  | NA   | NA       | NA |
| D  | Access to tank  | Required   | Provided | MR |
| E  | Overhead tank capacity  | 20,000 ltrs.   | Provided | MR |
| 15 | <b>Exit Signage:</b>  | Required   | Provided | MR |
| 16 | <b>Provision of Lifts:</b>  |  |          |    |
| A  | Pressurization of lift shaft  | NA   | NA       | NA |
| B  | Pressurization of lift lobby  | NA   | NA       | NA |
| C  | Communication in lift car   | NA   | NA       | NA |
| D  | Firemen's grounding switch  | NA   | NA       | NA |
| E  | Lift signage  | NA   | NA       | NA |
| 17 | <b>Standby Power Supply:</b>  | Required   | Provided | MR |
| 18 | <b>Refuge Area:</b>   |  |          |    |
| A  | Total area  | NA   | NA       | NA |
| B  | Location  | NA   | NA       | NA |
| 19 | <b>Fire Control Room :</b>  |  |          |    |
| A  | Detector system panel   | NA   | NA       | NA |
| B  | Flow switch panel   | NA-  | NA       | NA |
| C  | Pa system panel   | NA   | NA       | NA |
| D  | Battery backup  | NA   | NA       | NA |
| E  | Building floor plans  | NA   | NA       | NA |
| 20 | <b>Special Fire Protection Systems For Protection of Special Risks, If Any:</b> | LPG bank on terrace floor protected by sprinkler system. |          | MR |


The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspection.


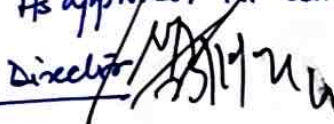
Keeping in view of the compliance of minimum standards of fire prevention and fire safety measures as required under the Rules 35 of the Delhi Fire Service Rules 2010, FSC for said premises is recommended upto 2<sup>nd</sup> floor only.

  
 Signature of the Inspecting Officer  
 Name Rajinder Atwal  
 Designation DO (CD)

  
 Signature of the Inspecting Officer  
 Name Sumit Kumar  
 Designation ADO (SPM)

~~Dy.CFO (NDZ)~~   
~~C.F.O~~

~~Director~~   
~~Director~~ 

As approved, FSC letter is ~~put~~  up for signatures pl.  
~~Director~~   
 28/10/24 