

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS : DELHI FIRE SERVICE, NEW DELHI - 110001

No: F6/DFS/MS/EH/NDZ/2024/356

Dated: 28/10/2024

FIRE SAFETY CERTIFICATE

Certified that the M/s KFC Restaurant (Sapphire Foods India Pvt. Ltd.) located at Shop No. 10 & 11, Ground Floor, Near Gate No. 01 at PD area of Kashmere Gate Metro Station, Delhi, building is comprised of Ground + 02 upper floors but restaurant is running at ground floor of PD area. The owner/ occupier of M/s KFC Restaurant (Sapphire Foods India Pvt. Ltd.) was granted FSC by this department vide letter no. F6/DFS/MS/2021/214 dated 07.09.2021. The building/ premises was re-inspected by the team of officers concerned of this department on 18.10.2024 in presence of Mr. Ajay (RGM) and found that the building/ premises has complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010. Accordingly, the premises is fit for occupancy class "Group - D Assembly" (restaurant at ground floor of PD area) with effect from28/10/2024 for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to conditions under Rule 38 of Delhi Fire Service Rules, 2010 printed below.

Issued on28/10/2024.....at New Delhi by


(Atul Garg)
Director

Delhi Fire Service
Tel: 011-23414000

Copy to:-

1. The Joint Commissioner of Police (Licensing), 1st Floor, Police Station Defence Colony, New Delhi: - Ref. MHA Portal ID. No. 2024100815400 dated 08.10.2024.
2. The Licensee, M/s KFC Restaurant (Sapphire Foods India Ltd.) at Shop No. 10 & 11 at PD area of Kashmere Gate Metro Station, Delhi.

Condition for the validity of fire safety certificate

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in.
7. The means of escape shall be kept unobstructed / unlocked for unhindered evacuation in case of an emergency.
8. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub Rule (I) of Rule 37] along with a copy of this Certificate, six month prior to its expiry. Any change in the occupancy shall be intimated to this Deptt. and approval shall be obtained thereto before occupancy of the same.

INSPECTION REPORT


1	Name & address of the building	M/S KFC Restaurant (Sapphire Foods India Ltd.) at Shop No. 10 & 11, Near Gate No. 1 at PD Area of Kashmere Gate Metro Station, Delhi - 06.		
2	Building is comprised of	(Ground + 02 upper floors) (restaurant at ground floor at shop no. 10 & 11 of PD area)		
3	Type of occupancy	Assembly Building (Group-D)		
4	Type of case	Renewal		
5	Details of previous FSC	F6/DFS/MS/2021/214 dated 07.09.2021		
6	Fire safety direction letter no.	NA		
7	Date of inspection	18.10.2024		
8	Name of the inspecting officers	Rajinder Atwal, DO (CD) & Sumit Kumar ADO (SPM)		
9	Name of the designation of officer from the building side	Mr. Ajay (RGM)		
10	Year of construction	2007		
11	Applicant's letter no.	Online application no. 2024100815400 dated 08.10.2024		
S.No	Minimum Standards on fire Prevention and fire safety requirements U/R 33	Requirement/ Existing fire safety arrangements	Provided at Site	Remarks MR/ NMR
1	Access To Building:			
	Road width	06 mtrs.	Provided	MR
	Gate width	NA	NA	NA
	Width of internal road	NA	NA	NA
2	Number, Width, Type and Arrangement of Exits:			
	A	Number of staircases		
		a Upper floor	NA	NA
		b Basement	NA	NA
	B	Width of staircases		
		a Upper floor	NA	NA
		b Basement	NA	NA
	C	Protection of exits		
		a Fire check door	NA	NA
		b Pressurization	NA	NA
	D	No. of continuous staircases to terrace	NA	NA
	E	Width of corridor	NA	NA
	F	Door size	1.5 mtrs.	01 no.- 1.5 mtrs. & 01 no.- 2.0 mtrs. MR
3	Compartmentation:			
	A	Fire check door	NA	NA
	B	Sealing of electrical shafts	Required	Provided
	C	Fire rating of shaft door	NA	NA
	D	Water curtain	NA	NA
	E	Fire dampers	NA	NA
4	Smoke Management System:			
	A	Upper floors	12 ACPH	Natural
	B	Basements	30 ACPH	Mechanical


5.	Fire Extinguisher:				
	A	Total numbers	06 nos.	06 nos.	MR
	B	Types	ABC & Co2	ABC & Co2	MR
	C	ISI marking	Required	Provided	MR
6	First-Aid-Hose Reels:				
	A	Total numbers on each floor	01 no.	01 no.	MR
	B	Length of hose reel hose	30 mtrs.	30 mtrs.	MR
	C	Nozzle diameter	05 mm	05 mm	MR
7	Automatic Fire Detection And Alarming System:				
	A	Type of detectors (smoke)	Required	Provided	MR
	B	Location of main panel	Ground floor	Ground floor (FCR)	MR
	C	Location of repeater panel	Fire control room	Near shop No. 9 & 10	MR
	D	Alternate source of power	Required	Provided	MR
	E	Hooters Location	Required	Provided at ground floor	MR
8	MOEFA:		Required	Provided	MR
9	Public Address System:		Required	Provided	MR
10	Automatic Sprinkler System:				
	A	Basement/lower ground	Required	Provided	MR
	B	Upper floor	Required	Provided	MR
	C	Sprinkler above false ceiling	Required	Provided	MR
11	Internal Hydrants:				
	A	size of riser/down-comer	150 mm	Provided	MR
	B	Number of hydrants per floor	01 no.	01 no.	MR
	C	Hose box	01 no.	01 no.	MR
12	Yard Hydrants:				
	A	Total number of hydrants	NA	NA	NA
	B	Hose box	NA	NA	NA
13	Pumping Arrangements:		Combined pump with metro station		
	A	Ground level			
	a)	Discharge of main pump	2280 LPM	2280 LPM	MR
	b)	Head of main pump	60 m	60 m	MR
	c)	Number of main pumps	02 no.	02 no.	MR
	d)	Jockey pump out put	180 LPM	180 LPM	MR
	e)	Jockey pump head	60 m	60 m	MR
	f)	Standby pump out put	2280 LPM	2280 LPM	MR
	g)	Standby pump head	60 m	60 m	MR
	h)	Auto starting /manual stopping	Required	Provided	MR
	B	Terrace level			
	a)	Discharge of pump	450 LPM	450 LPM	MR
	b)	Head of the pump	40 mtrs.	40 mtrs.	MR
	c)	Power supply	Required	Provided	MR
	d)	Auto starting of pump	Required	Provided	MR


14 Captive Water Storage For Fire Fighting:				
A	Underground tank capacity	1,00,000 ltrs.	1, 00,000 ltrs.	MR
B	Draw-off connection	Required	Provided	MR
C	Fire service inlet	Required	Provided	MR
D	Access to tank	Required	Provided	MR
E	Overhead tank capacity	20,000 ltrs.	Provided	MR
15	Exit Signage:	Required	Provided	MR
16 Provision of Lifts:				
A	Pressurization of lift shaft	NA	NA	NA
B	Pressurization of lift lobby	NA	NA	NA
C	Communication in lift car	NA	NA	NA
D	Firemen's grounding switch	NA	NA	NA
E	Lift signage	NA	NA	NA
17	Standby Power Supply:	Required	Provided	MR
18 Refuge Area:				
A	Total area	NA	NA	NA
B	Location	NA	NA	NA
19 Fire Control Room :				
A	Detector system panel	NA	NA	NA
B	Flow switch panel	NA	NA	NA
C	Pa system panel	NA	NA	NA
D	Battery backup	NA	NA	NA
E	Building floor plans	NA	NA	NA
20	Special Fire Protection Systems For Protection of Special Risks, If Any:		NA	NA


The fire protection systems provided in the building were tested, checked at random and found functional at the time of inspection.

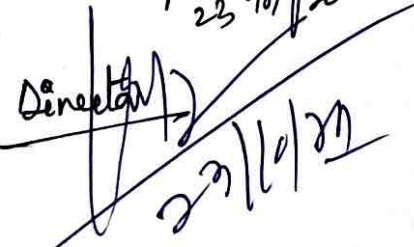
Keeping in view of the deemed compliance of minimum standards of fire prevention and fire safety measures as required under the Rules, the FSC issued vide letter no. F6/DFS/MS/2021/214 dated 07.09.2021 is recommended to be renewed (restaurant at ground floor of PD area) under Rule 35 of the Delhi Fire Service Rules 2010.

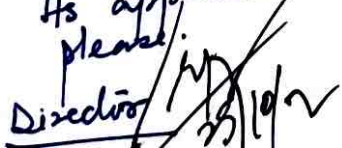

 Signature of the Inspecting Officer
 Name Rajinder Atwal
 Designation DO (CD)





 Signature of the Inspecting Officer
 Name Sumit Kumar
 Designation ADO (SPM)

~~Dy.CFO (NDZ)~~  22/10/24

C.F.O.  23/10/2024

~~Director~~  22/10/24

As approved, F.T. letter is put up for signature.
 please.  23/10/24

  28/10/24  29/10/24