

C-49

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE NEW DELHI-110001**

No. F6/DFS/MS/School/WZ/2024/ 1147

Dated: 29/11/2024

**FIRE SAFETY CERTIFICATE**

Certified that the **Aryans International School, Plot No.681, Kh. No.154, Near Sadh Maharaj Mandir, Pooth Khurd, Delhi-110039**, comprised of **Ground + One Upper floor** owned/occupied by **Aryans International School** was issued fire safety certificate by this department vide letter no **F.6/DFS/MS/School/WZ/2020/447 dated 27.10.2020**. The premises was re-inspected by the officer concerned of this department on **12.11.2024** in the presence of **Mr. Anil Kumar (Manager)** and observed that all the fire prevention and fire safety arrangements as provided in the premise found in good working condition. The premise have deemed complied with the requirements of circular issued by Director of Education vide letter no 3298-3398 dated 01.03.2011 and the building/ premise is fit for occupancy class **"B" Educational Buildings** with effect from 29/11/2024 for a period of **three years** subject to compliance of the conditions mentioned below.

Issued on 29/11/2024 at New Delhi by

  
(Atul Garg)  
DIRECTOR  
Ph; 011-23414000

De  
CN

**Copy to:**

1. The Principal, Aryans International School, Plot No.681, Kh. No.154, Near Sadh Maharaj Mandir, Pooth Khurd, Delhi-110039.
2. The Director of Education, GNCT of Delhi Old Secretariat, Delhi-110054.

**Conditions for validity of Fire Safety Certificate;**

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'j' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form "K" is available on [http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/) [http://www.delhi.gov.in/wps/wcm/connect/doit\\_fire/FIRE/Home/Forms](http://www.delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms)



2114

### INSPECTION REPORT

1. Name & address of the building		Aryans International School, Plot No.681, Kh. No.154, Near Sadh Maharaj Mandir, Pooth Khurd, Delhi-110039		
2. Type of Occupancy		Educational		
3. Type of Case		Renewal (Ground + 01 upper floor)		
4. Details of Previous NOC		F.6/DFS/MS/School/WZ/2020/447 dated 27.10.2020.		
5. Fire Safety directives letter No		Director of Education Cir. dated 01.03.2011		
6. Date of inspection		12.11.2024		
7. Name of Inspecting Officer		Sh. Ajay Kumar Sharma (ADO Rohini)		
8. Name and designation of officers From the building side		Mr. Anil Kumar (Manager)		
9. Year of Construction		2006		
10. Applicant's letter No.		Online e-mail dated 26.10.2024.		
S. No	Minimum Standards on fire prevention and fire safety U/R 33	Dir. of Edu. Requirement	Provided at site	Remarks MR/NMR
1.	<b>Access to building</b>			
	• Road width	Accessible	Accessible	MR
	• Gate width	Accessible	4.11m	MR(Old case)
	• Width of internal road	-NA-	-NA-	-NA-
2.	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	<b>g. Number of staircases</b>			
	• Upper Floors	02nos.	03nos.	MR
	• Basements	-NA-	-NA-	-NA-
	<b>h. Width of staircases</b>			
	• Upper Floor	1.5m	1.80m, 1.15m & 2.0m	MR
	• Basements	-NA-	-NA-	-NA-
	<b>i. Protection of exits</b>			
	• Fire check door	-NA-	-NA-	-NA-
	• Pressurization	-NA-	-NA-	-NA-
	<b>d. No. of continuous staircases to terrace</b>	-NA-	-NA-	-NA-
	<b>e. Width of Corridor</b>	-NA-	-NA-	-NA-
	<b>f. Door Size</b>	1.0m	1.10m	MR
3.	<b>Compartmentation</b>			
	• Fire check door	-NA-	-NA-	-NA-
	• Sealing of electrical shafts	-NA-	-NA-	-NA-
	• Fire Rating of shaft door	-NA-	-NA-	-NA-
	• Water Curtain	-NA-	-NA-	-NA-
	• Fire Dampers	-NA-	-NA-	-NA-
4.	<b>Smoke Management System</b>			
	c) Basements	-NA-	-NA-	-NA-
	d) Upper floors	-NA-	-NA-	-NA-
5.	<b>Fire Extinguishers</b>			
	• Total numbers	04nos.	12nos.	MR
	• Types	ABC/CO2	ABC-12nos.	MR
	• IS marking	ISI marked	Yes	MR
6.	<b>First-Aid Hose Reels</b>			
	• Total numbers on each floor	-NA-	-NA-	-NA-
	• Length of hose reel hose	-NA-	-NA-	-NA-

My



2/15


17. Standb

	• Nozzle diameter	-NA-	-NA-	-NA-
<b>7.</b>	<b>Automatic fire detection and alarming system</b>			
	f) Type of detectors	-NA-	-NA-	-NA-
	g) Location of Main Panel	-NA-	-NA-	-NA-
	h) Location of Repeater Panel	-NA-	-NA-	-NA-
	i) Alternate source of power	-NA-	-NA-	-NA-
	j) Hooters' Location	-NA-	-NA-	-NA-
<b>8.</b>	<b>MOEFA</b>	-NA-	-NA-	-NA-
<b>9.</b>	<b>Public Address System</b>	-NA-	-NA-	-NA-
<b>10.</b>	<b>Automatic Sprinkler System</b>			
	• Basement	-NA-	-NA-	-NA-
	• Ground & Upper Floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
<b>11.</b>	<b>Internal Hydrants</b>			
	• Size of riser/down-comer	-NA-	-NA-	-NA-
	• Number of hydrants per floor	-NA-	-NA-	-NA-
	• Hose Box	-NA-	-NA-	-NA-
<b>12.</b>	<b>Yard Hydrants</b>			
	• Total number of hydrants	-NA-	-NA-	-NA-
	• Hose Box	-NA-	-NA-	-NA-
<b>13.</b>	<b>Pumping Arrangements</b>			
	• Ground Level	-NA-	-NA-	-NA-
	➤ Discharge of main Pump	-NA-	-NA-	-NA-
	➤ Head of Main pump	-NA-	-NA-	-NA-
	➤ Number of main pumps	-NA-	-NA-	-NA-
	➤ Jockey Pump out put	-NA-	-NA-	-NA-
	➤ Jockey pump head	-NA-	-NA-	-NA-
	➤ Standby Pump out put	-NA-	-NA-	-NA-
	➤ Standby Pump Head	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual Stopping	-NA-	-NA-	-NA-
	➤ Pump House Access	-NA-	-NA-	-NA-
	Terrace level			
	➤ Discharge of pump	-NA-	-NA-	-NA-
	➤ Head of the pump	-NA-	-NA-	-NA-
	➤ Power Supply	-NA-	-NA-	-NA-
	➤ Auto Starting of pump	-NA-	-NA-	-NA-
<b>14.</b>	<b>Captive Water Storage for fire fighting</b>			
	• Underground tank capacity	-NA-	-NA-	-NA-
	➤ Draw-off connection	-NA-	-NA-	-NA-
	➤ Fire service inlet	-NA-	-NA-	-NA-
	➤ Access to tank	-NA-	-NA-	-NA-
	• Overhead Tank capacity	-NA-	-NA-	-NA-
<b>15.</b>	<b>Exit Signage.</b>	-NA-	-NA-	-NA-
<b>16.</b>	<b>Provision of Lifts.</b>			
	• Pressurization of Lift Shaft	-NA-	-NA-	-NA-
	• Pressurization of Lift lobby	-NA-	-NA-	-NA-
	• Communication In lift Car	-NA-	-NA-	-NA-
	• Fireman's Grounding Switch	-NA-	-NA-	-NA-




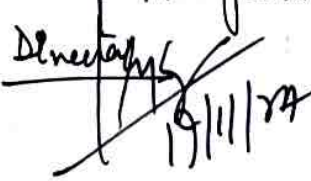
	• Lift Signage	-NA-	-NA-	-NA-
17.	Standby power supply	-NA-	-NA-	-NA-
18.	Refuge Area.			
	➤ Total Area	-NA-	-NA-	-NA-
	➤ Location	-NA-	-NA-	-NA-
19.	Fire Control Room			
	• Detector System Panel	-NA-	-NA-	-NA-
	• Flow Switch Panel	-NA-	-NA-	-NA-
	• PA System Panel	-NA-	-NA-	-NA-
	• Battery backup	-NA-	-NA-	-NA-
	• Building Floor Plans	-NA-	-NA-	-NA-
20.	Special Fire Protection System for Protection of special Risks, if any:	-NA-	-NA-	-NA-


Accordingly, the fire protection systems provided in the building were tested/ checked randomly and found in working condition at the time of inspection.

Keeping in view the satisfactory compliance of the minimum standards on fire prevention and fire safety required as stipulated in Director of Education, and removal of shortcomings issued vide letter no. 201 dated 02.05.2024, the FSC issued vide letter no. F.6/DFS/MS/School/WZ/2020/447 dated 27.10.2020, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

  
 Signature of the Inspecting Officer  
 Name Ajay Kumar Sharma  
 Designation ADO(Rohini)

DO(NW)  
 DCFO/...  
 Dated.../18/11/2024

 18/11/2024  
 Dy CFO/WZ  
 18/11/2024  
 CFO  
 19/11/2024  
 Director  
 19/11/24

 ADO/ROH  
 FI letter is put up for kind perusal and signature please.

  
 Director

  
 27/11/24