

SS



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001



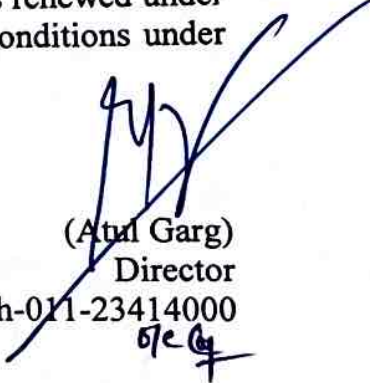
No. F6/DFS/MS/EH/2024/ 427

Dated: 28/12/2024

FIRE SAFETY CERTIFICATE

Certified that the M/s The Lalten located at Plot No-11, Block-2, Second Floor, Roop Nagar, Delhi-110007 in the building comprised of basement, stilt, upper ground & 03 upper floors owned/ occupied by M/s The Lalten was issued fire safety certificate vide letter no. F6/DFS/MS/2021/314 Dated 19.07.2021. The premises was inspected by the officer concerned of Fire Service on 18.12.2024 in the presence of Sh. Suresh Arora and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with Rules 33 of the Delhi Fire Service Rules, 2010 and building premises is fit for occupancy class "Group- D Assembly"(Restaurant) for second floor only with effect from 28-12-2024 for a period of three years, in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 28-12-2024 at New Delhi by


(Atul Garg)
Director
Ph-011-23414000
7/12/24

Conditions for the validity of Fire Safety Certificate:

1. This Fire Safety Certificate is valid only for restaurant at second for assembly occupancy only. In case of any violation, this FSC will be treated as null & void.
2. All the means of escape shall be kept free from any type of obstruction all the time.
3. All the employees shall be acquainted with the use and maintenance of all fire equipment and method of smooth and speedy safe evacuation of occupants in case of emergency
4. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seem during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
5. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities. This Fire Safety Certificate is valid only for permanent building structure as per plan.
6. This fire safety certificate may not be treated in any case of regularizations of unauthorized construction/unauthorized use of land or activities, if any.
7. Basement shall not be used for any other purpose except as specified in UBBL, subject to permission from concerned local authority.
8. The owner / occupier shall submit a declaration every year in Form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on the official website of Delhi Fire Service i.e. www.dfs.delhigovt.nic.in.
9. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".

INSPECTION REPORT

1. Name & address of the building : M/s The Lalten at Plot No 11, Block-02, Second Floor, Roop Nagar, Delhi-110007.
2. Type of Occupancy : Assembly (Restaurant)
3. Composition of building : Basement, Stilt, Upper Ground & 03 upper floors
4. Type of Case : Renewal
5. Details of previous NOC : Nil
6. Fire Safety directives letter No : NBC Part -IV
7. Date of inspection : 10.04.2021
8. Name of the Inspecting Officers : ADO (RN)
9. Name and designation of officers from the building side : Sh. Suresh Arora
10. Year of Construction : 2012
11. Applicant's letter No. : Online MHA Portal I D no.2024112817403 Dated: 03.12.2024


	Minimum Standards on fire prevention and fire safety U/R 33	BBL / NBC Part-IV Requirements	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	6m	06m	MR
	• Gate width	4.5	Directly Accessible	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	02	02	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper Floors	1.5m	Provided	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	NA	NA	NA
	d. No. of continuous staircases to terrace	NA	NA	NA
	e. Width of Corridor	NA	NA	NA
f. Door Size	1.50m	Provided	MR	
3	Compartmentation.			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4	Smoke Management System.			
	• Basements	NA	NA	NA
	• Upper floors	Required	Exhaust Fan	MR
5	Fire Extinguishers			
	• Total numbers	04nos	04nos	MR
	• Types	ABC & Co2	ABC- 04	MR

	• ISI marking	17/16 Yes	Yes	MR
6	First-Aid Hose Reels.			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30m	30m	MR
	• Nozzle diameter	5mm	5mm	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	Required	Provided	MR
	• Location of Main Panel	Required	Provided	MR
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	Required	Provided	MR
8	MOEFA	Required	Provided	MR
9	Public Address System.	NA	NA	NA
10	Automatic Sprinkler System.			
	• Basement	NA	NA	NA
	• Upper Floor	NA	Provided	NA
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down-comer	100mm	Provided	MR
	• Number of hydrants per floor	01	Provided	MR
	• Hose Box	01	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13	Pumping Arrangements.			
	• Ground Level			
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main pump	N/A	N/A	N/A
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey Pump out put	NA	NA	NA
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/ Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	450 LPM	450 LPM	MR
➤ Head of the pump	40m	40m	MR	
➤ Power Supply	Required	Provided	MR	
➤ Auto Starting of pump	Required	Provided	MR	
14	Captive Water Storage for fire fighting.			
	• Underground tank capacity	NA	NA	NA
	➤ Draw-off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	20,000 LTR	Provided	MR
15	Exit Signage.	Required	Provided	MR


16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication In lift Car	NA	NA	NA
	• Fireman's Grounding Switch	NA	NA	NA
	• Lift Signage	NA	NA	NA
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector System Panel	N/A	N/A	N/A
	• Flow Switch Panel	N/A	N/A	N/A
	• PA System Panel	N/A	N/A	N/A
	• Batter backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	NA	NA	NA


The fire protection systems provided in the building were tested/ checked and found in working condition at the time of inspection.

Keeping in view of the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules. It is recommended to renew Fire Safety certificate vide this department letter of even no. F6/DFS/MS/2021/314 Dated 09.07.2021.


 Signature of the Inspecting Officer
 Name :-C.L. Meena
 Designation:- ADO/RN

D.B. Mukharjee (DC/NW)


 20/12/2024
 Dy CBO (W2)


 20/12/2024


 Director
 26/12/2024

FT PH
 ADO/RN

DCFO/.....
 Dated...20/12/2024

conf. . P.T.O .