

238

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

NO. F-6/DFS/HQ/2021/ 405

Dated 09/08 /2021

To,

The Principal  
Nalanda Modern Public School,  
Sant Nagar, Main Road Burari, Delhi-84.

Sub: - Regarding issuance of fire safety certificate in r/o Nalanda Modern Public School, Sant Nagar, Main Road Burari, Delhi-110084.

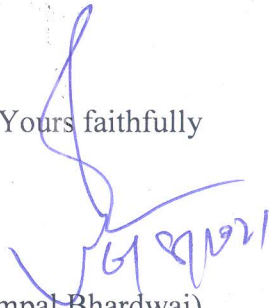
Sir,

Please refer to your letter received through online email dated 26.07.2021 on the subject cited above. In this connection this is to inform you that the above mentioned site was visited by the officer concerned of this department on 30.07.2021 to verify the fire safety measures issued vide NBC Part-IV and observed that the school premise is comprised of 02 blocks A block- basement, ground and three upper floor & B block- ground plus three upper floors (school is running on ground and three upper floors only). At the time of inspection Sh. D.P. Vats (President) was also present at site. During the course of inspection observations/ shortcomings made are as under:-

1. Fire extinguisher provided but not functional at the time of inspection.
2. Hose reel hose provided but not functional.
3. MOEFA system provided but not functional.
4. PA systems provided but not functional
5. Internal hydrant provided but found not functional.
6. Terrace level fire fighting pumps capacity of 450 lpm provided but not functional.
7. Terrace level fire water tank capacity of 20,000ltr being used for domestic purposes. Fire water tank must be dedicated to firefighting purposes only.
8. Exit signage and floor signage found removed at strategic locations in the school building.

Keeping in view of above, fire safety certificate cannot be considered at this stage

Yours faithfully

  
(Dharampal Bhardwaj)  
Dy. Chief Fire Officer  
Ph:-011-25156707

Copy to:-

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.