

e12

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI- 110001**

No. F.6/DFS/MS/GH/2021/SZ/ 750  
To

Dated: 01/11/2021

The Joint Commissioner of Police,  
1<sup>st</sup> Floor, P.S Defence Colony  
New Delhi 110049.

Sub: Issuance of NOC in r/o M/s Hotel Sunshine at A-139, Near MCD School, Main Vasant Kunj Road, Mahipalpur New Delhi-110037.

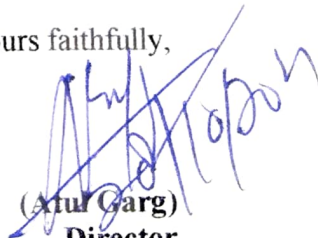

Sir,

This is in reference with MHA Portal ID 2021071015017 dated 12/07/2021 on the subject cited above. In this connection, the premises have been inspected by officer concerned of this department in the presence of Mr. Virender Kumar (owner) of the Guest House. During the inspection, it was observed that the Guest House is running Ground + Three Upper Floors. The shortcomings observed are as below:

1. There is one staircases having width of 1.20 mtr against the requirement having width of 1.50 mtr each as per UBBL-2016.
2. Fire check doors not provided in the building as per clause 7.31 of UBBL 2016
3. First Aid Hose Reel not provided.
4. The MOEFA system is not provided.
5. Carbon Monoxide detector not provided as per clause 7.31 of UBBL 2016.
6. Terrace level Fire Pump capacity of 450 LPM not provided.
7. Overhead tank capacity 20,000 ltrs not provided.
8. Exit Signage not provided at Strategical location.

In view of above Shortcomings, the application for issuance Fire Safety Certificate is rejected. The occupancy of the building/premises in absence of requisite fire safety arrangements shall be at the risk and liability of the owner/occupier. The Licensing authority/ Statutory Authority may take suitable necessary action as deemed fit.

Yours faithfully,

  
(Atul Garg)  
Director  


Copy to:-

1. M/s Hotel Sunshine at A-139, Near MCD School, Main Vasant Kunj Road, Mahipalpur New Delhi-110037