

C. 24

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F6/DFS/MS/WZ/School/2021/ 622

Dated: 30/11/2021

To,

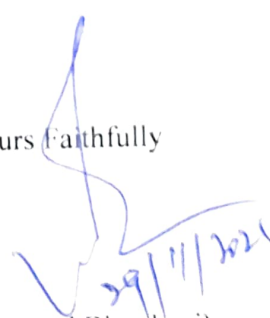
The Principal,  
Nigam Pratibha Vidyalaya,  
Sector-07A, Rohini,  
Delhi -85.

**Sub:** Issuance of Fire Safety Certificate in r/o Nigam Pratibha Vidyalaya, Sector-07A, Rohini, Delhi-85.

Sir,

Kindly reference to online mail dated 01.10.2021, received in this department on the subject cited above. In this connection it is to inform you that the shortcoming already issued by this department letter of even No. 3877 dated 28.06.2019 (Copy enclosed). Therefore, you are advised to submit point-wise compliance of shortcomings issued vide this department letter dated 28.06.2019 for further consideration in this matter.

Yours Faithfully

  
(Dhrampal Bhardwaj)  
Dy.Chief Fire Officer  
Tel:-01123414250

OK

NY

C-20

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

Dated 28/ 6/ 2019

NO. F-6/DFS/MS/ 2019/ 3877

To

The Principal  
Nigam Pratibha Vidyalaya,  
Sector-7A, Rohini, Delhi-110085.

**Sub: - Regarding issuance of fire safety certificate in r/o Nigam Pratibha Vidyalaya,  
Sector-07A, Rohini, Delhi-110085.**

Sir,

Please refer to your letter no. Nil dated 31.01.2018 on the subject cited above. In this connection this is to inform you that the above mentioned site was visited by the officer concerned of this department to verify the fire safety measures issued vide Director of Education circular dated 01.03.2011/ NBC Part 4 and observed that the building was comprised of ground plus two upper floor only. At the time of inspection Smt. Usha Rani .Principal was also present at site. During the course of inspection observations/ shortcomings made are as under:-

1. Hose reel hose not provided.
2. Terrace level fire pump capacity 450 lpm not provided.
3. Overhead tank capacity of 10,000 ltr. Not provided.
4. Exit signage's not provided at strategic location in the building.

Keeping in view of above, fire safety certificate cannot be considered at this stage

Yours faithfully

(Dharampal Bhardwa)

Dy.Chief Fire Officer

Ph.-011-25104544

*[Handwritten signature]*