

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F6/DFS/MS/School/WZ/2021/ 73

Dated: 17/02/2021

To,

The Principal,
Nigam Pratibha Co-ed School,
Sec-03, Pkt-F/G, Rohini,
Delhi-110085.

Sub: Issue of FSC in r/o Nigam Pratibha Co-ed School, Sec-03, Pkt-F/G, Rohini, Delhi-85.

Sir,

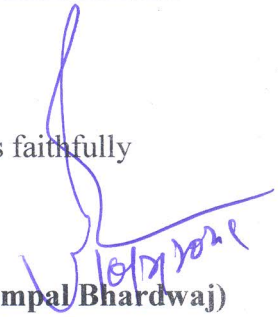
This is reference outdoor diary no.9863 dated 15.12.2020, on the subject cited above. The premise was inspected by the concern nominated authority of this department in presence of Mrs. Anita Nashier (Principal) on 10.02.2021 to verify the compliance of fire prevention and fire safety measures required under the rules. Following shortcoming has been observed during inspection.

1. Channel scissor gate provided in auditorium hall is not permitted in exit routes.
2. One staircase is found removed at second floor.
3. Hose reel are provided but nozzles found missing.
4. 07 fire extinguishers of ABC type provided & 01 found empty.
5. Terrace Fire pump with capacity 450 LPM found not installed.
6. Over Head water captive tank of 10,000 ltrs found not installed.
7. Exit signage not provided.

In this regard as stipulated in sub Rule (1) of Rule 37 of DFS Act-2007 & Rules 2010 you are advised to apply again in Form "I" along with a certificate from Architect/ owner that all the fire prevention and fire safety measures are provided as per Rule 33 of DFS Act-2007/ Rules 2010 in the building/premise & duly filled Performa enclose herewith. The Form "I" is available on website of this department under.

http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/
http://www.delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Forms

Yours faithfully


(Dhrampal Bhardwaj)
Dy.Chief Fire Officer
Tel:-01123414250

01 c
24