

C 9

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F6/DJS/MS/EH/2022/252

Dated 17/03/2022

To

The Joint Commissioner of Police (Lic.),
Police Station, Defence Colony, 1st floor,
New Delhi

Sub:-Regarding issuance of Fire Safety Certificate in respect of M/s. Dhaba Restaurant (a unit of Kay Aar Hospitality), Shop No. 2F/07, 2nd Floor, Pacific Mall, Netaji Subhash Place, New Delhi.

Sir,

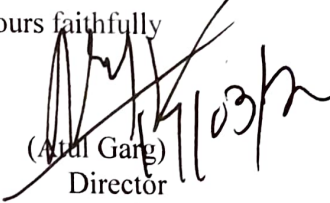
Please refer to the online application ID-20220201113053 received through MHA portal regarding the subject cited above. In this connection, it is to inform you that the building has been inspected by the officer concerned of this department to check the status of the fire safety & means of escape arrangement required as per law/code.

During the course of inspection, it was observed that the restaurant is running at second floor in a building comprised of 02 tier basement, lower ground, ground plus four upper floors. Fire safety arrangements such as fire extinguishers, first aid hose reel, internal hydrant system, overhead water storage tank capacity 20,000 lts, fire pump etc. found provided. However, following shortcomings were observed: -

1. Exit door passing through the kitchen is not allowed. One alternate exit door having width 1.5 mts is required.
2. Exit signages are not provided.

In view of above shortcomings, the application for issuance of Fire Safety Certificate is not considered at this stage & rejected. The occupancy of the building/premises in absence of requisites fire safety measures shall be at the risk and liabilities of the owner/occupier.

Yours faithfully


(Atul Garg)
Director
Delhi Fire Service

Copy to:-

1. Sh. Grusha Arora, M/s. Dhaba Restaurant (a unit of Kay Aar Hospitality), Shop No. 2F/07, 2nd Floor, Pacific Mall, Netaji Subhash Place, New Delhi.
2. The DHO, Keshav puram Zone, North DMC, Kesav Puram, Wazirpur, New Delhi.

16/3/2022