

330

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE**  
**NEW DELHI- 110001**

No. F6/DFS/MS/School/2022/SZ/187

Dated: 20/04/2022

To,

The Principal,  
K.R.D. International School,  
Village-Issapur, New Delhi-110073.

**Sub:-**Regarding issue of "Fire Safety Certificate" from fire safety point of view in r/o K.R.D. International School, Village-Issapur, New Delhi-110073.


Sir,

Please refer to your letter Nil Dated 29/03/2022 on the subject cited above. In this connection this is to inform you that officer concerned of this department inspected the school to verify the fire safety arrangements in accordance with the Rules. At the time of inspection Mr. Vipin Kumar (Manager) was present and it was observed that the school building is comprised of ground plus two upper floors and have following shortcomings:-

1. Three fire extinguishers are provided in place of eight.
2. First Aid Hose reels not provided.
3. Fire pump having 450 LPM output at 40 m head not provided.
4. Over head tank capacity of 10,000 liters not provided
5. Exit signage's are not provided.

In view of above, the fire safety certificate cannot be considered at this stage. You are requested to rectify the above shortcoming under the intimation to this department for further course of action.

Yours faithfully,

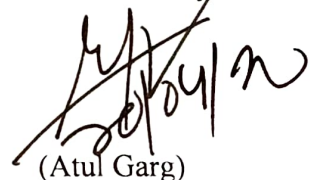

(Atul Garg)

**Director**

Delhi Fire Service

Copy to:-

1. The Director of Education,  
Govt. of NCT of Delhi, Old Secretariat,  
New Delhi-110054.

**(With a request to take further action as school does not have fire NOC)**

