

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI – 110001

No. F6/DFS/MS/Hospital/2022/WZ/ 953

Dated: 29/04/2022

To,

The Authorized Signatory,
Jivodaya Hospital,
Ashok Vihar, Phase-1, Delhi-110052.

Subj:- Regarding renewal of Fire Safety Certificate in r/o 'Jivodaya Hospital Located at Ashok Vihar, Phase-1, Delhi-110052.


Sir,

Please refer to your email dated 16.03.2022 on the subject cited above. In this connection it is to inform you that the above said building were re-inspected by the officer concerned of this department on 28.03.2022 in the presence of Ms. Deepthy SD (Administrator). Fire Safety arrangement such as fire extinguishers, fire aid hose reel, smoke management system, automatic fire detector & alarming system, fire pumps & underground water tank etc. found provided. However, the following shortcomings have observed:-

1. Fire Check Door found removed from basement floor staircase.
2. Fire pump are not in auto mode.
3. Overhead water tank for firefighting 8,000 ltrs capacity found empty instead of requirement 10,000 ltrs.

In view of the above shortcomings, the application for renewal of Fire Safety Certificate is rejected. The occupancy of the building/premises in absence of requisite fire safety arrangements shall be at the risk and liability of the owner/occupier. The Licensing Authority/Statutory Authority may take suitable necessary action as deemed fit.

Yours faithfully,

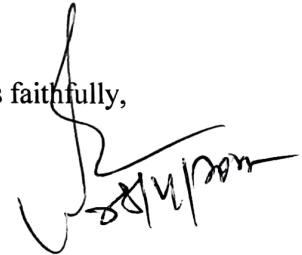

(Dharampal Bhardwaj)
Dy. Chief Fire Officer
(West Zone)