

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI – 110001

No. F6/DFS/MS/2022/WZ/233

Dated: 18/05/2022

To,

The Principal,
G. D. Goenka Public School,
A-2, Paschim Vihar,
Near A-1, Gurudwara, Delhi-110063.

Subj:- Regarding renewal of Fire Safety Certificate in respect of G. D. Goenka Public School Located at A-2, Paschim Vihar, near A-1, Gurudwara, Delhi-110063

Sir,

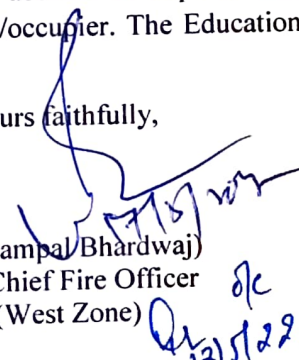
This has reference to your letter no form 'J' dated 21.03.2022 on the subject cited above. In this connection, it is to inform you that the said school building was re-inspected by the officer concerned of this department on 27.04.2022 in the presence of Sh. Tilak Raj Verma (Admin.).

During the inspection, it was observed that the building is comprised of Ground + 03 Upper Floors. Fire Safety arrangements such as fire extinguishers, first aid hose reel, exit signages & Overhead water storage tank etc found provided. However, the following points have been noticed as shortcomings:-

1. A Terrace pump of 450 lpm & jockey pump 180 lpm capacity found removed.
2. First Aid Hose reel & hydrants found non-functional.
3. Overhead water storage tank 5000 ltrs capacity for firefighting found empty.
4. Exit signages are inadequate.
5. Kitchen running in temporary 04 rooms constructed on terrace floor using LPG cylinder in bulk to be stopped & room to be dismantled.
6. Existing multipurpose hall constructed with temporary structure to be regularized /sanctioned by building department i.e. MCD.
7. Electrical panel provided underneath staircase to be removed.

In view of the above shortcoming, the application for renewal of Fire Safety Certificate is rejected. The occupancy of the building/premises in absence of requisite fire safety arrangements shall be at the risk and liability of the owner/occupier. The Education Authority may take suitable necessary action as deemed fit.

Yours faithfully,


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
(West Zone)

Copy to:-

1. The Director, Directorate of Education, GNCT of Delhi, Old Secretariat Delhi – 110054