

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No.F6/DFS/MS/School/2022/ 249

Dated 26/05/2022

To

The Principal
Govt. Sarvodaya Vidyalaya, No-03
Shakti Nagar, Delhi-110007.

Sub: Regarding issuance of fire safety certificate in r/o Govt. Sarvodaya Vidyalaya, No-03, (I.D No.1207011), located at Shakti Nagar, Delhi-110007.

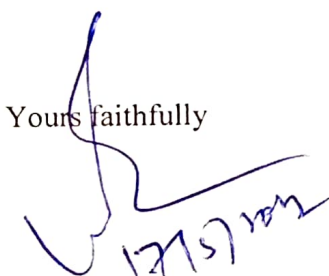
Sir,

Please refer to your letter no. GSV.NO.03/SV/465 dated 07.04.2022 and received in this office vide outdoor dairy no.246 dated 08.04.2022 on the subject cited above. In this connection this is to inform you that the above mentioned site was visited by the officer concerned of this department on 06.05.2022 to verify the fire safety measures issued vide NBC Part-IV/ Director of Education circular dated 01.03.2021 and observed that as per earlier Fire Safety Certificate issued by this department letter of even no.1473 dated 18.07.2019 the building was comprised of ground and 03 upper floors only. At the time of inspection Sh. Pawan Kr. Sharma (Estate Manager) was also present at site. During the course of inspection observations/ shortcomings made are as under:-

- 1 Fire extinguisher provided in the building but not functional.
- 2 Hose reel hose provided but not functional and some nozzle are missing.
- 3 Terrace level fire fighting pump capacity of 450lpm provided but not functional.
- 4 Terrace level fire water tank capacity of 10,000ltrs provided but found empty.
- 5 Exit signage's found removed at strategic locations in the building.

Keeping in view of above, fire safety certificate cannot be considered at this stage.

Yours faithfully


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
Ph:-011-23414250

Copy to:-

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.