

C-52

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No-F.6/DFS/MS/School/ 2022/370

Dated 04/07/2022

To

The Principal
St. Johns Convent Sr. Sec. School,
B-4659/12, Street No.112, Sant Nagar,
Burari, Delhi-110084.

Sub: - Regarding issuance of fire safety certificate in r/o St. Johns Convent Sr. Sec. School located at B-4659/12, Street No.112, Sant Nagar, Burari, Delhi-110084.


Sir,

This has refer to your letter No.STJCSSS/00452/UR/22 dated 07.05.2022 and received in this department vide outdoor dairy no. 1201 dated 09.05.2022 on the subject cited above. In this connection this is to inform you that the above mentioned site was visited by the officer concerned of this department on 17.06.2021 to verify the fire safety measures issued vide NBC Part- IV and observed that the school premise is comprised of ground and four upper floors. At the time of inspection Sh. G.R. Pant (Principal) was also present at site. During the course of inspection observations/ shortcomings made are as under:-

1. Fire extinguisher provided but not functional at the time of inspection and short in no's.
2. First aid hose reel hose provided but not functional.
3. Down comer system provided but found damaged/leakage condition needs to be repair properly.
4. Terrace level fire fighting pumps capacity of 450lpm provided but not functional and pump are not an auto mode.
5. Exit signage and floor signage found removed at strategic locations in the building.

Keeping in view of above, fire safety certificate cannot be considered at this stage

Yours faithfully

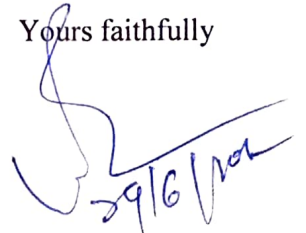

(Dharampal Bhardwaj)
Dy. Chief Fire Officer
Ph:-011-23414250

Copy to:-

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.