

7-5 C/43

  
**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS, DELHI FIRE SERVICE, CONNAUGHT PLACE**  
**NEW DELHI**

No. F6/DFS/MS/WZ/EH/2022/ 489

Dated: 26/7/2022

To,

The Authorized Signatory,  
M/s. Raftaar (A unit of AAA Hospitality)  
15-C, 2<sup>nd</sup> & 3<sup>rd</sup> floor, NWA, Punjabi Bagh,  
New Delhi -110026.

**Sub: -Inspection report in r/o M/s. Raftaar (A unit of AAA Hospitality) 15-C, 2<sup>nd</sup> & 3<sup>rd</sup> Floor, NWA, Punjabi Bagh, New Delhi -110026.**

Sir,

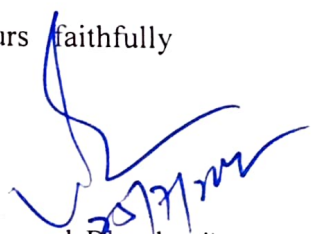
Please refer to your E.mail letter on dated 28.06.2022 regarding to revoke the suspension of the Fire safety certificate issued by this department vide letter no.F6/DFS/MS/WZ/EH/2019/2139 dated 14.11.2019. In this regard it is to inform you that the said building/premises was inspected by the officer concerned of this department on 08.07.2022 in presence of Sh. Sujit Mishra(GM) to check the shortcomings already issued by this department vide letter no. DFS/ADO/MN/2022/29 dated 25.05.2022.

The status of the shortcomings are as under:-

1.	Standby diesel pump removed	Not Rectified
2.	Hose reel hose, Hydrant, Sprinkler found not working.	Not Rectified
3.	L.P.G bank provided in staircase shall be removed	Not Rectified
4.	Only 10,000 Ltrs O.H Tank is provided against the requirement of 60,000 Ltrs.	Not Rectified
5.	Ventilation system is removed. Exit signage removed at some places. Room in staircase landing shall be removed.	Not Rectified

In view of above, suspension of Fire safety certificate cannot be revoked at this stage.

Yours faithfully

  
(Dharampal Bhardwaj)  
Dy. Chief Fire Officer  
Delhi fire Service

Copy To:-

- 1: The Dy. Health Officer, West zone, South Delhi Municipal Corporation, Rajouri Garden, New Delhi. ([dhowestzone@gmail.com](mailto:dhowestzone@gmail.com)).
  2. The Joint Commissioner of Police, Licensing Unit, 1<sup>st</sup> floor, Police Station, Defence Colony, New Delhi. ([adllep.lic-dl@nic.in](mailto:adllep.lic-dl@nic.in))
- o/c RAH  
2/7/22