



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F6/DFS/MS/2022/NDZ/ 458

Dated: 4 / 8 / 2022

To

The Manager,
Karan Public School, B-27,
Street No.-1, Sadatpur Extn.,
Karawal Nagar, Delhi-110094.

**Sub.:- Inspection Report in r/o Karan Public School, B-27, Street No.-1, Sadatpur Extn.,
Karawal Nagar, Delhi-110094.**

Sir,

With reference to your letter No KPS/09/447/2022 dated 20/05/2022 on the subject noted above. In this connection, it is to inform you that the said building premises was inspected by the officer concerned of this department on 20.07.2022 in the presence of Sh. Jabar Singh (Manager).

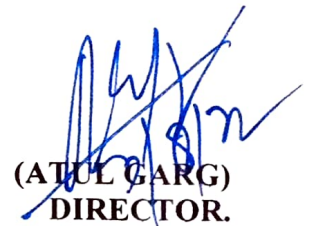
During the course of inspection it was observed that the building premises is comprised of Ground, 1st Floor & 2nd Floor Only (Earlier school was G+1 upper floor only).

However following shortcomings were observed during the time of inspection:-

1. 2 staircase of width 1.60mtr & 1.30mtr provided against requirement of 2 staircase of with 1.50mtr each.
2. Hose Reel Hose found removed.
3. Fire Pump of 450 Lit/min capacity not provided.
4. Overhead tank capacity of 10,000 ltrs not provided.
5. Exit Signage not provided.

In view of above shortcomings, the application for issuance Fire Safety Certificate is rejected. The occupancy of the building / premises in absence of requisite fire safety arrangements shall be at the risk and liability of the owner / occupier.

Yours faithfully,


(ATUL GARG)
DIRECTOR.

Copy to :-

1. Director of Education, Old Secretariat, Civil Lines, Delhi-110054.

