

C 40

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No F6/DFS/MS/2022/School/ 523

Dated 5 / 9 /2022

To

The Principal
Murti Devi Public School,
Bhagat Colony, West Sant Nagar,
Burarir, Delhi-110084.

Sub: - Regarding issuance of fire safety certificate in r/o Murti Devi Public School located at 221, A-2 Block, Bhagat Colony, West Sant Nagar, Burarir, Delhi-110084.

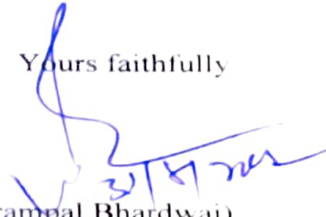
Sir,

This has reference to your letter no. Nil and received in this department vide outdoor dairy no. 4100 dated 04.08.2022 on the subject cited above. In this connection this is to inform you that the above mentioned site was visited by the officer concerned of this department on 17.08.2022 to verify the fire safety measures installed in the building as per NBC- Part-4. During the course of inspection it was observed that the school premise is comprised of Ground plus 02 upper floors only. At the time of inspection Sh. Ram Shankar Singh (Chairman) was also present at the site and the observations made are as under:-

1. Fire extinguisher provided but not functional.
2. Hose reel hose provided but not functional and hose reel pipe damaged/leakage condition, some nozzles found missing.
3. Terrace level fire pump capacity of 450lpm provided but not functional.
4. Terrace level fire water tank capacity of 5000ltr provided but found empty.
5. Exit signage found missing at some places at strategic locations in the building.

Keeping in view of above, fire safety certificate cannot be considered at this stage

Yours faithfully


(Dharampal Bhardwaj)
Dy. Chief Fire Officer
Ph:-011-23414250

Copy to: -

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 54.