

C-10

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

No.F6/DFS/MS/School/2022/577

Dated: 15/09/2022

To

Prof. Shobha Sinha (Head & Dean)  
Department of Education,  
University of Delhi.

Sub: Regarding issuance of fire safety certificate in r/o CIE Basic and Experimental School located at Delhi University, Faculty of Education, Near Khalsa Collage, Delhi-110007.


Sir,

Please refer to your letter no. Nil and received in this office vide outdoor dairy no.2263 dated 08.06.2022 on the subject cited above. In this connection this is to inform you that the above mentioned site was visited by the officer concerned of this department on 30.08.2022 to verify the fire safety measures issued Director of Education Circular 262-362 dated:17.01.2005 and observed that the building was comprised of ground & first floor only. At the time of inspection Mr. Grish Kumar (Asst. Registrar) was also present at site. During the course of inspection observations/ shortcomings made are as under:-

- 1 Only one nos. of staircase provided width of 1.06m and one more staircase required against the width of 1.50m in case of emergency.
- 2 Fire extinguisher provided but not functional and 02 nos. of extinguisher more required of school building.
- 3 Exit signage not provided at strategic locations in the school building.
- 4 During the inspection we saw that all the electrical wires not proper conduit pipe/open and damaged condition needs to repair.


Keeping in view of above, fire safety certificate cannot be considered at this stage.

Yours faithfully

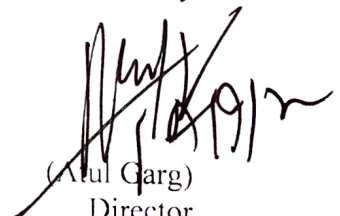

(Atul Garg)  
Director

Ph:-011-23414000



Copy to:-

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 54.