



**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001**



No: F.6/DFS/MS/School/WZ/2022/ 721

Dated: 28/11/2022

To

The Principal,  
Jagannath International School,  
D-Block, Pushpanjali Enclave,  
Pitampura, New Delhi- 110034.

Sub:- Regarding renewal of Fire Safety Certificate in r/o Jagannath International School, D-Block, Puanpanjali Enclave, Pitampura, Delhi- 110034.

Sir,

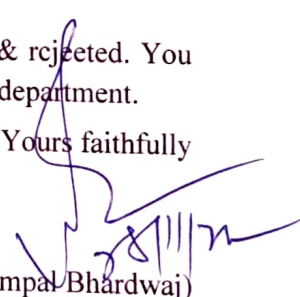
This is in reference to your letter No. JIS/2022-23/09/1239 dated 20.09.2022 on the subject cited above. In this connection, it is to inform you that the school building was inspected by the officer concerned of this department in your presence on 18.11.2022 to check the status of the fire safety arrangements already provided in the school building.

During the course of inspection, it was observed that the school building is comprised of basement, ground plus three upper floors. Fire safety arrangements such as fire extinguishers, first aid hose reel, MOEFA, sprinkler system in basement floor, down comer, terrace fire pumps capacity 450 & 180 LPM, etc. found provided. However, following shortcomings were observed:

1. Terrace pumps are provided but not on auto mode.
2. MOEFA & PA system found provided but not functional.
3. Exit signages found removed at some places.
4. Sealing of Third floor found broken and in use for classroom purpose.
5. Hose reel hose nozzle found missing.

In view of the above, fire safety certificate cannot be renewed at this stage & rejected. You are advised to rectify the above mentioned shortcomings under intimation to this department.

Yours faithfully

  
(Dharampal Bhardwaj)  
Dy. Chief Fire Officer  
West Zone

Copy to: -

1. The Directorate of Education, Old Secretariat, Delhi- 110054.