

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, CONNAUGHT PLACE

NEW DELHI

No. F6/DFS/MS/WZ/EH/2022/180

Dated: 11/02/2022

To,

The Joint Commissioner of Police,
 Licensing Unit, 1st floor, Police Station,
 Defence Colony, New Delhi.
adlep.lic-dl@nic.in

Sub: - Inspection report in r/o M/s. Kay Aar Hospitality (A unit of Dhaba Estd -1986 delhi)- SH,2F 12, Second Floor, Pacific Mall, Khayla New Delhi.

Sir,

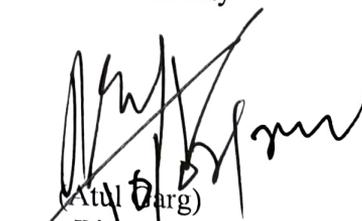
This is in reference to the online application received through MHA portal vide ID-2021122829490 dated 14/01/2022, regarding issuance of Fire Safety Certificate in respect of aforesaid restaurant. In this connection, it is to inform you that the premises was inspected by officers concerned of this department on 02/02/2022 in the presence Sh. Nirdosh sareen to check the fire safety arrangements provided in the building.

During the course of inspection, it was observed that the said restaurant is running at Second floor of Pacific Mall comprised of 02 tier basements, ground plus four upper floors and projection room. Fire safety arrangements of the restaurant are interlinked with Mall's fire safety system. However, following shortcoming was observed: -

1. Two Exit doors having width 1 X 1.75 mts & 1 x 1.45 mts are provided against the required width of 1.50 mts each.
2. Exit Signage's are not provided.
3. 2nd exit is passing through kitchen.
4. Access corridor to the alternate exit is less than required width (1.5 mts).

In view of above Shortcomings the application for Issuance of Fire safety Certificate is rejected. The occupancy of the Building/ premises in absence of requisite fire safety arrangements shall be at the risk and liabilities of the Owner/occupier. The licensing issuing authority/statutory authority is requested that premises should not be allowed to run till it provide all necessary fire arrangements.

Yours faithfully


 (Atul Darg)
 Director
 Delhi Fire Service

Copy to: -

1. The Owner/ Occupier M/s. Kay Aar Hospitality (A unit of Dhaba Estd -1986 delhi)- SH,2F 12, Second Floor, Pacific Mall, Khayla New Delhi.
2. The DHO, West Zone, SDMC, Shivaji Enclave, Raja Garden, New Delhi-110027.
 Email Id : - (dhowest zone@gmail.com)


 09/02/2022