

C-27

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F6/DFS/MS/SCHOOL/WZ/ 2022/91

Dated: 03/03/2022

To

The Principal,  
Guru Nanak Public School,  
Moti Nagar, New Delhi - 110015.

**Sub: - Inspection report in respect of Guru Nanak Public School, Located at Moti Nagar, New Delhi - 110015.**

Sir,

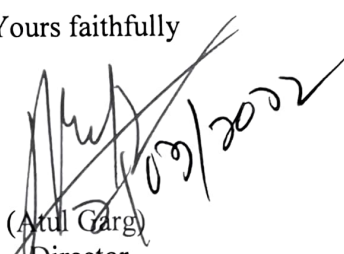
Please refer to your Email dated 03/02/2022 on the subject cited above. In this connection, it is to inform you that the said building/premises was inspected by the officer concerned of this department on 21/02/2022 in presence of Sh. Parminder Pal Singh (Manager) to see the functioning of fire safety equipments provided in the building.

During inspection, it has been observed that the above said school is running at 2nd floor in a building is comprised of Ground plus Two upper floors and Two rooms at terrace (Another school Namely Bhai Biba Singh Khalsa Sr. Sec. School is running at Ground & 1<sup>st</sup> floor in same building). However, the following Shortcomings were observed.

1. The width of staircase is 125 cm instead requirement of two staircase 1.5 m each.
2. Terrace pump of 450 lpm is provided but found nonfunctional.
3. Overhead water tank of 10,000 ltrs. capacity is provided but found empty.

In view of above Shortcomings the application for Issuance of Fire safety Certificate is rejected. The occupancy of the Building/ premises in absence of requisites fire safety arrangements shall be at the risk and liabilities of the Owner/occupier. The educational authority is requested that premises should not be allowed to run till it provide all necessary fire arrangements.

Yours faithfully

  
(Atul Garg)  
Director  
Delhi Fire Service

Copy to: -

1. The Director, Directorate of Education, old secretariat, Delhi.

  
28/02/2022