

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No: F.6/DFS/MS/School/2023/WZ/ 283

Dated: 30/05/2023

To,

The Principal,  
Nigam Uttkrisht Vidyalaya,  
Pana Udyan-1, Narela,  
Delhi-110040.

Sub: - Regarding issuance of Fire Safety Certificate in r/o Nigam Uttkrisht Vidyalaya, Pana Udyan-1, Narela, Delhi-110040.

Sir,

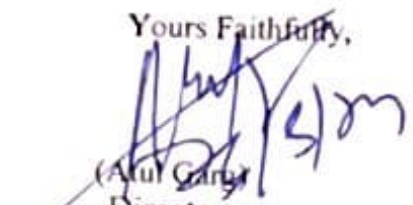
This has reference to your letter no. nil dated 21.04.2023 received via e mail id dated 21.04.2023 on the subject cited above. In this connection, it is to inform you that the inspection of above said school building has been carried out by the officer concerned of this department on 11.05.2023 to see the compliance of the requisite fire safety measures. Sh. Krishan Kumar (Teacher In-charge) was present at the time of inspection.

During the course of inspection it was observed that school building was comprised of Ground floor plus two upper floors. Your request for issuance of FSC is rejected due to the following shortcomings:-

1. There is only 01 continuous staircase up to the terrace while another staircase approaches only up to first floor against the required 02 continuous staircases up to the terrace.
2. First-Aid Hose Reels not provided.
3. Terrace level fire pump of 450 lpm capacity not provided.
4. Exit Signage's not provided.

You are advised to rectify the above-mentioned shortcomings under intimation to this department..

Yours Faithfully,

  
(Atul Garg)  
Director  
Ph. 011-23414000  
ou R

Copy to:-

1. Director of Education, MCD, Civic Center, New Delhi