

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS : DELHI FIRE SERVICE, NEW DELHI - 110001**

Dated: 13/06/2023

No. F6/DFS/MS/GH/NDZ/2023/ 276

To

The Joint Commissioner of Police (Licensing),  
1<sup>st</sup> Floor, Police Station Defence Colony,  
New Delhi.

**Sub:** Regarding renewal of Fire Safety Certificate in respect of M/s Hotel Wall City situated at  
287, Fatehpuri, Delhi - 06.

Sir,

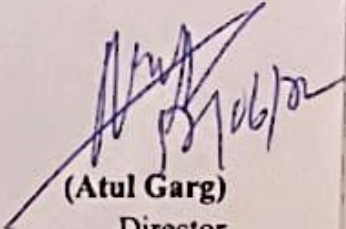
This has reference to online application I.D. no.2023052509612 dated 25.05.2023 on the subject cited above. It is to inform you that the guest house was inspected by the officer concerned from this department on 07.06.2023 in the presence Mr. Pardeep Singh (Manager). During inspection, following shortcomings were observed:

1. Fire check door which is required as per gazette notification dated 27.05.2019, not provided.
2. CO detectors with panel and alarm which are required as per gazette notification dated 27.05.2019, not provided.
3. Over head water storage tank capacity of 3,000 ltrs. provided against the required of 5,000 ltrs. exclusively for fire fighting.
4. Plan for ground floor and section elevation plan have not be provided with application.

In view of above shortcomings, the application for issuance for Fire Safety Certificate is rejected. The occupancy of the building/premises in absence of requisite fire safety arrangements shall be at the risk and liability of the owner/occupier. The Authority/Statutory Authority may take suitable necessary action as deemed fit.

The applicant is requested to rectify the shortcomings at the earliest for further action.

Yours faithfully,

  
(Atul Garg)

Director

Delhi Fire Service

Tel: 011-23414000

**Copy to:-**

The Licensee,

M/s Hotel Wall City at 287, Fatehpuri, Delhi - 06.