

c/117

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F6/DFS/MS/WZ/School/2023/314
To,

Dated: 08/08/2023

The Principal,
Junior St. Angel's School,
A-Block, Sector-16, Rohini,
Delhi-110089.

Sub: Issue of FSC in r/o Junior St. Angel's School, A-Block, Sector-16, Rohini, Delhi-89.


Sir,

This is in reference to your letter No. nil dated nil received through outdoor diary no. 1224 dated 25.04.2023 on the subject cited above. The premise was inspected by the concern nominated authority of this department on 30.06.2023, in presence of Mr. Achint to ascertain the availability and operability of the fire prevention and fire safety measures. Your request for renewal of FSC is rejected under sub rule (3) of Rule 37 of DFS Rules-2010 due to following reason:

1. Hose reel provided but not functional and hose reel nozzle missing at some place.
2. Smoke Management System in basement not provided.
3. Sprinkler system found removed at some places in basement.
4. Terrace fire pump of 450 lpm is provided but not functional.
5. Temporary ply board rooms found to be constructed in basement.

In this regard as stipulated in sub Rule 37 of DFS Rules, 2010 you may apply with a fresh application for renewal of fire safety certificate under sub-rule (2) on Form "J" with compliance of above shortcomings. The web links for DFS Act-2007/ Rules 2010 & Form "J" are as under:
http://www.delhi.gov.in/wps/wcm/connect/doi_t_fire/FIRE/Home/Fire+Safety+Acts+and+Rules/htp://www.delhi.gov.in/wps/wcm/connect/doi_t_fire/FIRE/Home/Forms

Yours faithfully

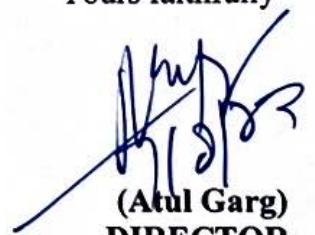

(Atul Garg)
DIRECTOR

Ph; 011-23414000

021
04