

C-16

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110 001

No. F6/DFS/MS/2023/SZ/College/262

Dated: 14/11/2023

To,
✓ The Principal,
Sant Hari Dass College of Higher Education,
Opp. Air Force Station, Bani Camp,
Najafgarh, New Delhi-110043.

Sub:- Regarding Issuance of Fire Safety Certificate in r/o M/s Sant Hari Dass College of Higher Education, Opp. Air Force Station, Bani Camp, Najafgarh, New Delhi-110043.

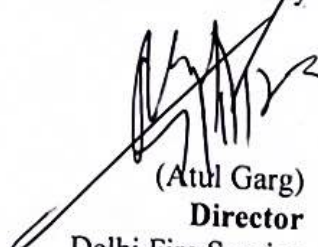
Sir,

This is in reference to your letter No. dated on the subject cited above. In this connection, it is to inform you that the inspection of above said building has been carried out by officer concerned of this department on 04/11/2023 in presence of Sh. Shri Bhagwan. During the course of inspection it was observed that the building is comprised of Basement, ground floor plus three upper floors. The following shortcomings were observed:-

1. Fire Check doors found removed at basement.
2. Exhaust fans are not provided in basement.
3. First aid hose reel system provided but not functional.
4. Automatic Sprinkler System provided in basement but not functional.
5. Fire pump having 450 (2 Nos.) lpm provided but not functional.
6. Overhead tank capacity 5,000 ltrs provided instead of 15,000 ltrs at terrace.
7. Exit signage's provided but not sufficient.

Keeping in view of above, the building cannot be considered for issuance of fire safety certificate, at this stage. Therefore you are advised to rectify the above said shortcomings under the intimation to this department for further course of action.

Yours Faithfully


(Atul Garg)
Director
Delhi Fire Service

o/c

Copy:-

The Director of Education,
Govt. of NCT of Delhi, Old Secretariat,
New Delhi-110054.