

c/57

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI - 110001

NO. F6/DFS/MS/SZ/2024/ 154

DATED: 27/03/2024

To,

The President / Secretary
Progressive Enclave CGHS Ltd.
Plot No-03, Sector-03, Dwarka,
New Delhi-110078.

**Subject: - Renewal of Fire Safety Certificate in r/o Progressive Enclave CGHS Ltd.
Located at Plot No-03, Sector-03, Dwarka, New Delhi-110078.**

Sir,

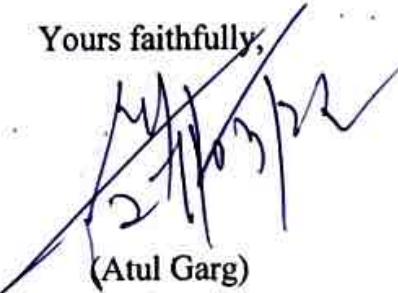
Please refer to your Form J, dated-01/03/2024 on the subject cited above. In this connection it is to inform to you that the above said residential building has been re-inspected by the officer concerned of this department on 22/03/2024 in the presence of Sh. S.P Gupta (Treasurer) from fire safety point of view.

During the course of inspection followings shortcoming have been observed:-

1. Six meter wide internal road around the building found encroached.
2. Only one ABC type fire extinguisher of 4 kg capacity found provided at each floor against required two fire extinguishers.
3. Hose reel & Hydrants found nonfunctional.
4. Hoses and Branches found missing at some places.
5. MOEFA found nonfunctional.
6. P.A. System found nonfunctional.
7. Terrace pumps found nonfunctional.
8. Exit signage's found removed at some places.
9. Communication system in lift car found nonfunctional.

In view of the above shortcomings renewal of Fire Safety Certificate from fire safety point of view cannot be considered at this stage. You are directed to comply the shortcomings under intimation to this department for further consideration in the matter.

Yours faithfully,


(Atul Garg)
(Director)

Delhi Fire Service

Copy to:-

1. The Joint Director, DDA, Vikas Sadan, INA, New Delhi.