

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

No.F6/DFS/MS/SZ/2024/ 206

Dated: 19/04/2024

To,
The Authorized Signatory
National Disaster Response Force,
Sector - 8, Pocket -14,
Dwarka, New Delhi.

Sir,

Subject: Issuance of Fire safety Certificate from fire safety & means of escape point of view in National Disaster Response Force, Located at Sector - 8, Pocket -14, Dwarka, New Delhi.

Sir,

Please refer to your letter No- Outdoor diary no-14508, dated 21/03/2024 on the subject mentioned above. In this connection it is to inform you that the inspection of the premises was carried out by the officer concerned of this department on 15/04/2023 in the presence of Sh. Rahul pandey .

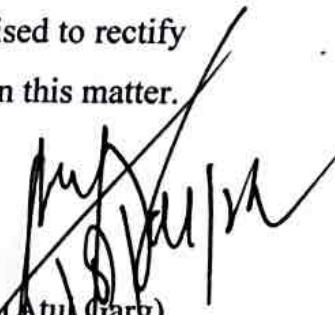
The following shortcomings were observed during the inspection:-

1. Only one staircase is provided for upper floors in SOs block against required two staircases of 1.5m & 1.35m width.
2. Smoke exhaust system found not provided in basement.
3. All the pumps provided at ground level & terrace level found nonfunctional.
4. Pressurization system in Lift shaft found not provided.

Hence Fire Safety Certificate cannot be considered at this stage and you are advised to rectify the aforesaid shortcoming under intimation to this department for further consideration in this matter.

Copy to; -

1. The Joint Director, DDA, Vikas Sadan, New Delhi.


(Atul Garg)
Director,
Delhi Fire Service.
ok
19/04/24