



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001



No. F6/DFS/MS/2024/School/ 330

Dated: 14/06/2024

To

The Manager,
Bright Star Convent Public School
at A-153, Phool Bagh Road Shastri Park
Ext Burari, Delhi-110084

Sub: - Regarding issuance of fire safety certificate in r/o Bright Star Convent Public School at A-153, Phool Bagh Road Shastri Park Ext Burari, Delhi-110084

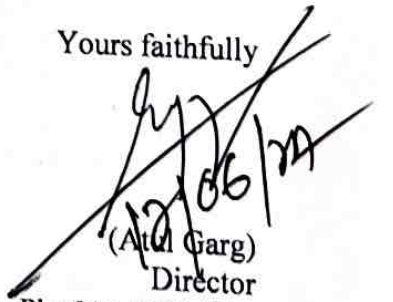
Sir,

Please refer to your letter received through online e-mail dated 03.06.2024 on the subject cited above. In this connection this is to inform you that the above mentioned school building was inspected by the officer concerned of this department on 06.06.2024 in the presence of Sh. Omvir Singh (Owner) was also present at site to check the existing fire safety measures & means of escape measures and observed that as per earlier Fire Safety Certificate issued by this department letter of even no.F6/DFS/MS/2021/WZ/School/163 dated 01.03.2021 the building was comprised of ground + 02 upper floor but school is running at ground + first floor only. Now the building is comprised of Ground + 03 upper floor. The observations/ shortcomings made are as under:-

1. 02 nos of staircase is provided width of 1.50m & 1.20m against the requirement of 1.50m each and both staircases from ground to terrace level.
2. The fire extinguisher is provided 06nos. against the requirement of 12 no's.
3. First aid hose reel hose is provided but not functional.
4. MOEFA system is not provided.
5. Terrace level fire pump capacity of 220lpm is provided against the requirement of 450lpm.
6. Terrace level fire fighting water tank capacity of 4000ltr is provided against the requirement of 10, 000ltr.
7. Exit signage and floor signage found removed at strategic locations in the school building.

Keeping in view of above, grant of Fire Safety Certificate cannot be considered at this stage & rejected. You are requested to rectify the abovementioned shortcomings under intimation to this department; till such time running of school is at your own risk & responsibility.

Yours faithfully


(Atul Garg)
Director
Ph:-011-23414000
etc

Copy to:-

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.