

CSB

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI - 110001

No.F6/DFS/MS/SZ/2024/ 376

Dated: 28/06/2024

To

The Addl. Commissioner of Police,
Licensing Unit 1st Floor,
P.S Defence Colony,
New Delhi-110049

Subject: - Renewal of Fire Safety Certificate in r/o M/s Radiance Guest House located at Ground, 1st & 2nd floor 15A/51, WEA Karol Bagh, New Delhi - 110005.

Sir,

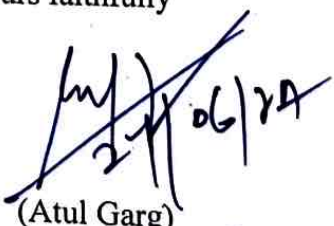
Please refer to online application No. 2024053108564, dated 31/05/2024 on the subject mentioned above. In this connection it is to inform you that the inspection of the premises was carried out by the officer concerned from this department on 24/06/2024 in the presence of Sh. Jassi (Manager) from fire safety point of view.

During the course of inspection following shortcomings are observed:

1. Hose reel hose system found non functional.
2. CO detectors found not provided.
3. MOEFA & PA system found non functional.
4. Automatic sprinkler system found nonfunctional in basement.
5. Terrace pump of capacity 450 lpm found nonfunctional

In view of the above shortcomings renewal of Fire Safety Certificate from fire safety point of view cannot be considered. The applicant is directed to comply the shortcomings under intimation to this department for further consideration in the matter.

Yours faithfully


(Atul Garg)

Director
Delhi Fire Service

OK


28/06/24

Copy to: - The Manager, M/s Radiance Guest House located at Ground, 1st & 2nd floor
15A/51, WEA Karol Bagh, New Delhi - 110005.