

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI - 110001

No.F6/DFS/MS/SZ/2024/412

Dated: 22/07/2024

To,

The President,
RWA Golden Heights
Pocket 08, Sector - 12, Dwarka,
New Delhi-110075.

Subject: - Renewal of fire safety certificate in r/o RWA Golden Heights Located at Pocket 08, Sector - 12, Dwarka, New Delhi-110075.

Sir,

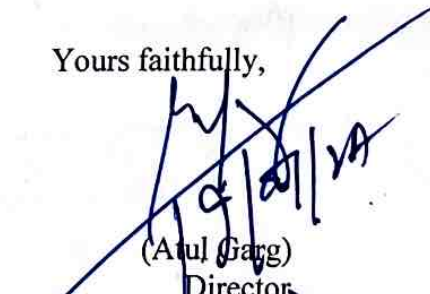
Please refer to your letter No- RWA/DDA/E/13dated -07/06/2024 on the subject mentioned above. In this connection it is to inform you that the premise was re-inspected by the officer concerned of this department on 15/07/2024 in the presence of Sh. Basant (Manager) from fire safety point of view.

During the course of inspection following shortcomings have been observed

1. Fire extinguishers are found rusted at some floors, required to be replaced.
2. Hose reel hose and hydrants found nonfunctional/ damaged.
3. MOEFA found nonfunctional.
4. PA system found nonfunctional.
5. All the pumps at ground level found nonfunctional.
6. Communication system in lift car found nonfunctional.

In view of the above shortcomings renewal of Fire Safety Certificate from fire safety point of view cannot be considered at this stage. You are directed to comply the shortcomings under intimation to this department for further consideration in the matter.

Yours faithfully,


(Atul Garg)
Director
Delhi Fire Service.

Copy to:-

The Joint Director (Building) DDA, Vikas Sadan, INA, Delhi-110023.