



GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001



No. F6/DFS/MS/2024/School/ 476

Dated: 30/07/2024

To,

The Principal,
 Govt. Girls Sr. Sec. School
 Nathupura, Tomer Colony, Delhi-84

Sub:- Regarding issuance of fire safety certificate in r/o Govt. Girls Sr. Sec. School, (School ID No-1207110/1207111) located at Nathupura, Tomer Colony, Delhi-110084.


Sir,

Please refer to your letter no- 473/ZVI/ Dated 03.07.2024 received in this department vide outdoor dairy no-3816 dated 03.07.2024 on the subject cited above. In this connection this is to inform you that the above mentioned site was visited by the officer concerned of this department on 20.07.2024 to check the existing fire safety measures. During inspection it has been observed that the school premise is comprised of 03 blocks interconnected, ground & 02 upper floors only. At the time of inspection Sh. Sheojee Singh (Principal) was also present at site. During the course of inspection the observations/ shortcomings made are as under:-

1. There is 04 nos. of staircases provided width of 1.50m & 1.40m each from ground to 2nd floor and 1.25m from ground to first floor only, (terrace made by hut type) against the requirement of one more staircase for 'B-block' width of 1.50m from ground to 2nd floor.
2. 15 no's of extinguisher is provided against the requirement of 05 more extinguisher in the school building.
3. Hose reel hose is not provided.
4. Terrace level fire pump capacity of 450lpm is not provided.
5. Terrace level fire water tank capacity of 10,000ltr is not provided.
6. Exit and floor signage's is not provided at strategic locations in the school building.

Keeping in view of above, renewal of Fire Safety Certificate cannot be considered at this stage & rejected. You are requested to rectify the above mentioned shortcomings under intimation to this department; till such time running of school is at your own risk & responsibility.

Yours faithfully

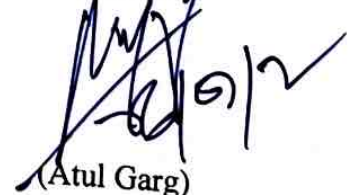

(Atul Garg)
 Director

Ph:-011-23414000

Copy to:-

1. The Deputy Director of Education, Zone-VII, District North Lucknow Road, Timarpur, Delhi-110054.
2. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi - 110054.