

c/17



**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001**



No. F6/DFS/MS/2024/School/474

Dated: 30/07/2024

To  
Sh. Chandramohan Goyal (Chairmen)  
Sri Hanuman Mandir Sec. School  
At Block-37, Shakti Nagar, Delhi-110007.

**Sub:** - Regarding renewal of fire safety certificate in r/o Sri Hanuman Mandir Sec. School located at Block-37, Shakti Nagar, Delhi-110007.

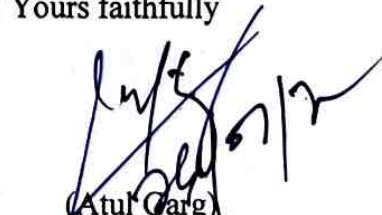
Sir,

Please refer to your letter No. SHMSS/2024/122 Dated 06.07.2024 received in this department vide outdoor dairy no.3846 dated: 08.07.2024 on the subject cited above. In this connection this is to inform you that the above mentioned site was visited by the officer concerned of this department on 20.07.2024 to check the existing fire safety measures. During inspection it has been observed that the school premise is comprised of ground & 03 upper floors but school is running at first, second & third floor only. At the time of inspection Mrs. Shalini Deshwal (Incharge) was also present at site. During the course of inspection the observations/shortcomings made are as under:-

1. Fire extinguisher provided but found not functional.
2. Hose reel hose is provided but not functional.
3. MOEFA system provided but not functional.
4. Terrace level fire pump capacity of 450lpm found removed at site.
5. Terrace level fire water tank capacity of 5000ltr found empty & damaged condition.
6. Exit and floor signage's found removed at strategic locations in the school building.

Keeping in view of above, renewal of Fire Safety Certificate cannot be considered at this stage & rejected. You are requested to rectify the above mentioned shortcomings under intimation to this department; till such time running of school building is at your own risk & responsibility.

Yours faithfully

  
(Atul Garg)  
Director  
Ph:-011-23414000

Copy to:-

1. The Director, Education, Government of N.C.T of Delhi. Old Sectt. Delhi-110054.