

c/2

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI- 110001**

No.F6/DFS/MS/NDZ/School/2024/785

Dated: 25/ 11 /2024

To

The Principal,  
Aminia Muslim Girls School,  
2075, 2079, Ahata Kale Qasim Jaan,  
Ballimaran Road, Chandni Chowk, Delhi - 110006.

**Sub: - Regarding issuance of "Fire Safety Certificate" from fire safety point of view in r/o Aminia Muslim Girls School at 2075, 2079, Ahata Kale Qasim Jaan, Ballimaran Road, Chandni Chowk, Delhi - 06.**

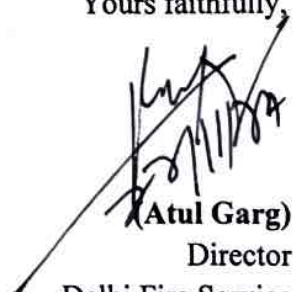
Sir,

This has reference to letter outdoor diary no. 6692 dated 19.09.2024 received in this department, on the subject cited above. In this connection, this is to inform you that the school building was visited by the officer concerned from this department on 06.11.2024 in the presence of Mohd. Nasif (Caretaker) and observed that the building is comprised of basement + ground + 03 upper floors. During the inspection, following shortcomings were observed:

1. Road width is less than required width 06 meter. Hence building is not accessible to fire engine.
2. There is one staircase in basement having width of 1.0 m against the required width of 1.5 m.
3. Smoke management system not provided in basement.
4. Fire extinguisher's not adequately provided.
5. Alternate power supply not provided.
6. Fire pump not in auto start mode.
7. Exit signages are not adequately provided.
8. Classes conducted in basement for computer lab, which is not allowed as per NBC part IV & UBBL 2016.

In view of above shortcoming, the application for issuance for Fire Safety Certificate is rejected. The occupancy of the building/ premises in absence of requisite fire safety arrangements shall be at the risk and liability of the school management.

Yours faithfully,

  
(Atul Garg)

Director  
Delhi Fire Service  
Tel: 011-23414000

o/c  
20/11/2024

**Copy to:-**

The Director of Education,  
Govt. of NCT of Delhi, Old Secretariat, Delhi.